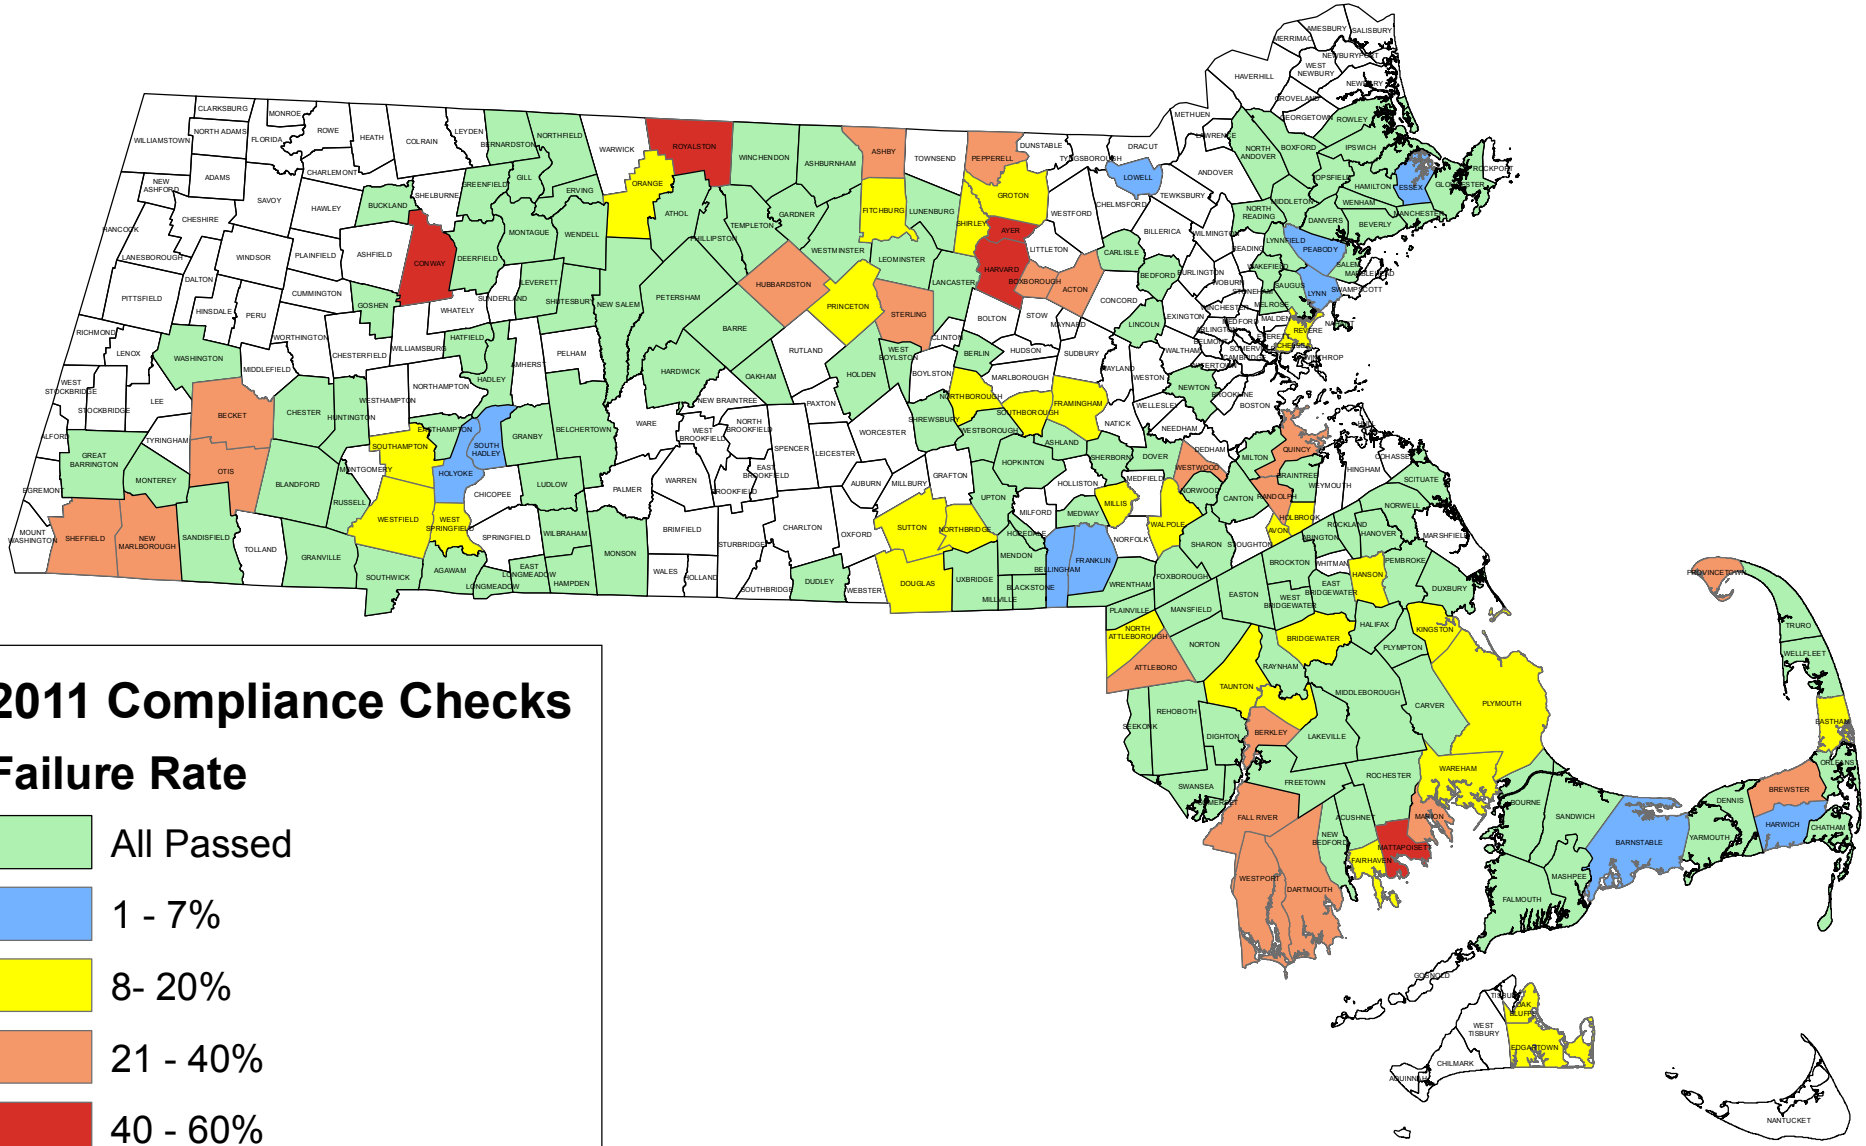

2011 Compliance Checks

Failure Rate

- All Passed
- 1 - 7%
- 8- 20%
- 21 - 40%
- 40 - 60%
- Massachusetts

Massachusetts Alcoholic Beverages Control Commission