2.13: continued

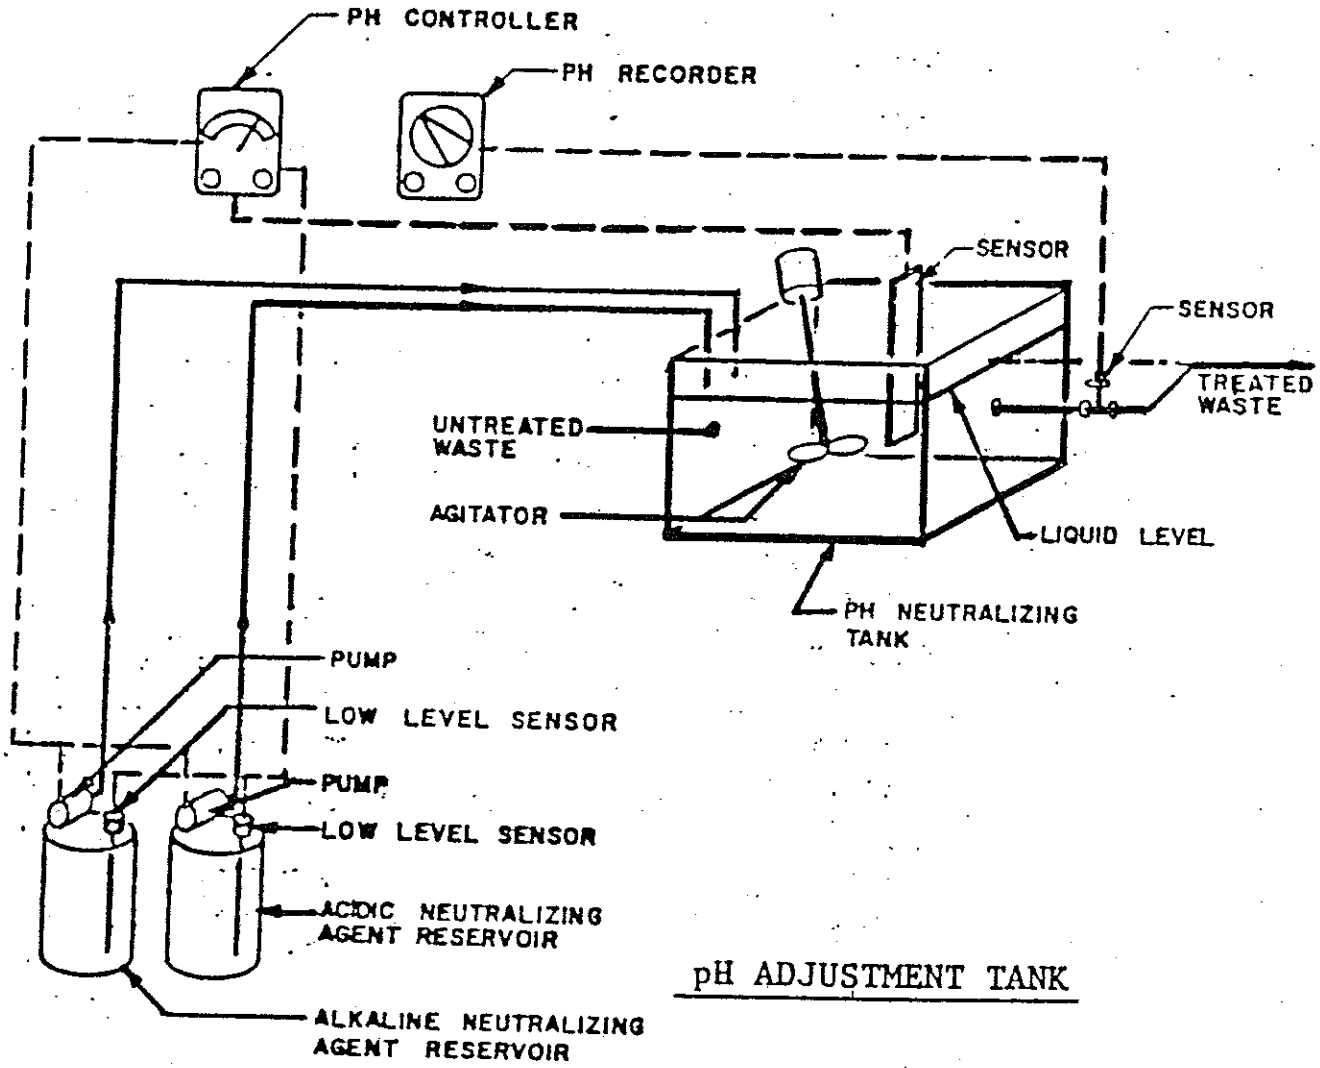

pH ADJUSTMENT TANK

CONTRACT NO. 90028		TITLE Inipure Lowell, MA	pH ADJUSTMENT SYSTEM
APPROVALS	DATE		
DRAWN SDA	11-20-90	ADA Associates Inc.	814 COMMERCIAL ST. SUITE 603 MALDEN, MA 02148 617-322-2100
CHECKED		CONSULTING ENGINEERS	
		DATE 11-20-90	DWG. NO. SK-2 REV.