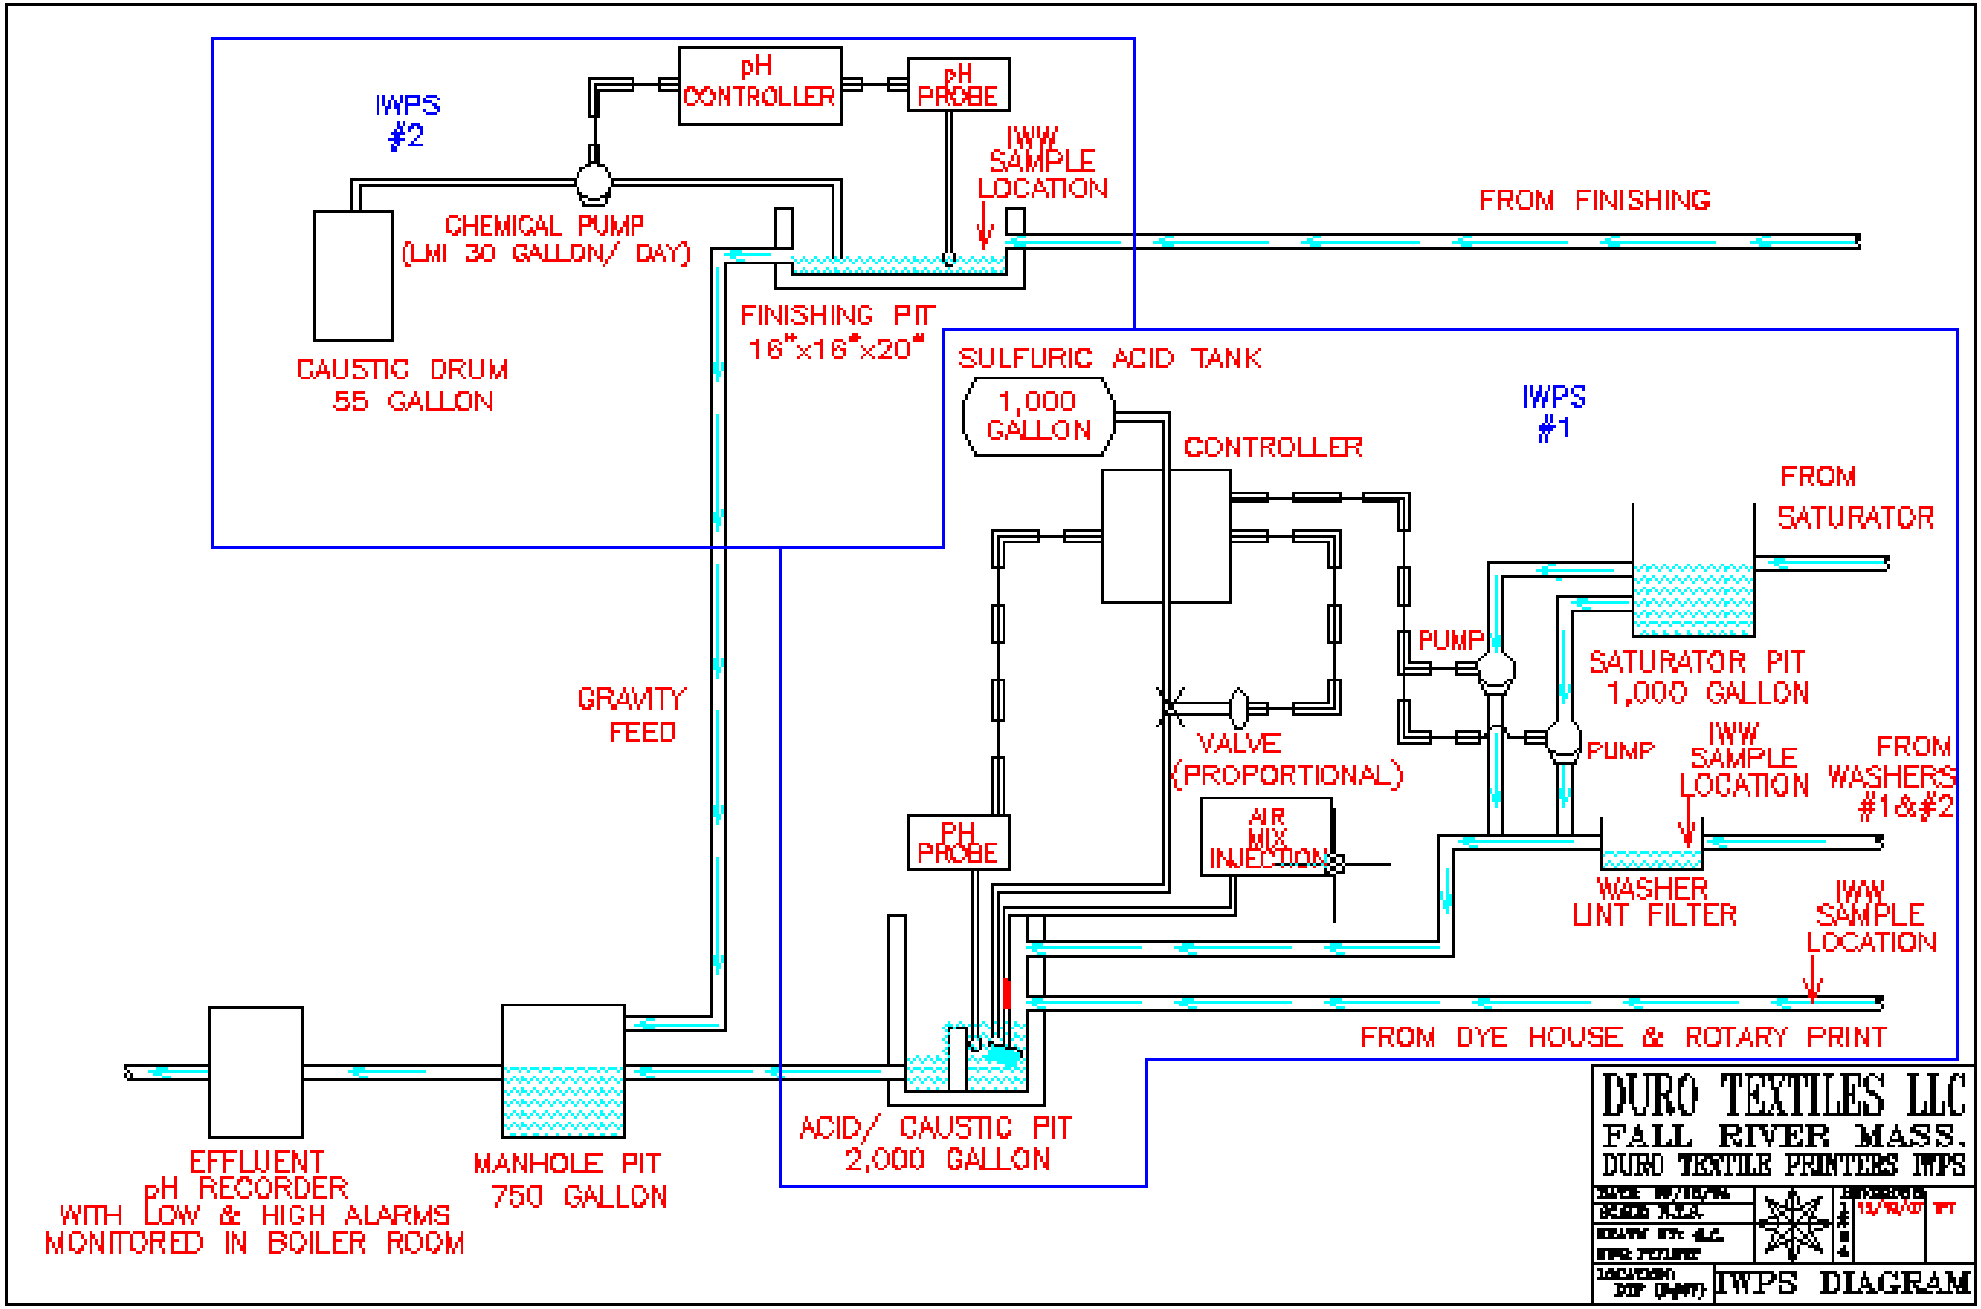
IWPS #2
pH CONTROLLER
pH PROBE
IWW SAMPLE LOCATION
FROM FINISHING
CHEMICAL PUMP (LMI 30 GALLON/ DAY)
CAUSTIC DRUM 55 GALLON
FINISHING PIT 16"x16"x20"
SULFURIC ACID TANK
1,000 GALLON
CONTROLLER
IWPS #1
FROM SATURATOR
PUMP
SATURATOR PIT 1,000 GALLON
GRAVITY FEED
VALVE (PROPORTIONAL)
PUMP
IWW SAMPLE LOCATION
FROM WASHERS #1&#2
AIR MIX INJECTION
pH PROBE
WASHER LINT FILTER
IWW SAMPLE LOCATION
FROM DYE HOUSE & ROTARY PRINT
EFFLUENT pH RECORDER WITH LOW & HIGH ALARMS MONITORED IN BOILER ROOM
MANHOLE PIT 750 GALLON
ACID/ CAUSTIC PIT 2,000 GALLON
DURO TEXTILES LLC
FALL RIVER MASS.
DURO TEXTILE PRINTERS IWPS
IWPS DIAGRAM