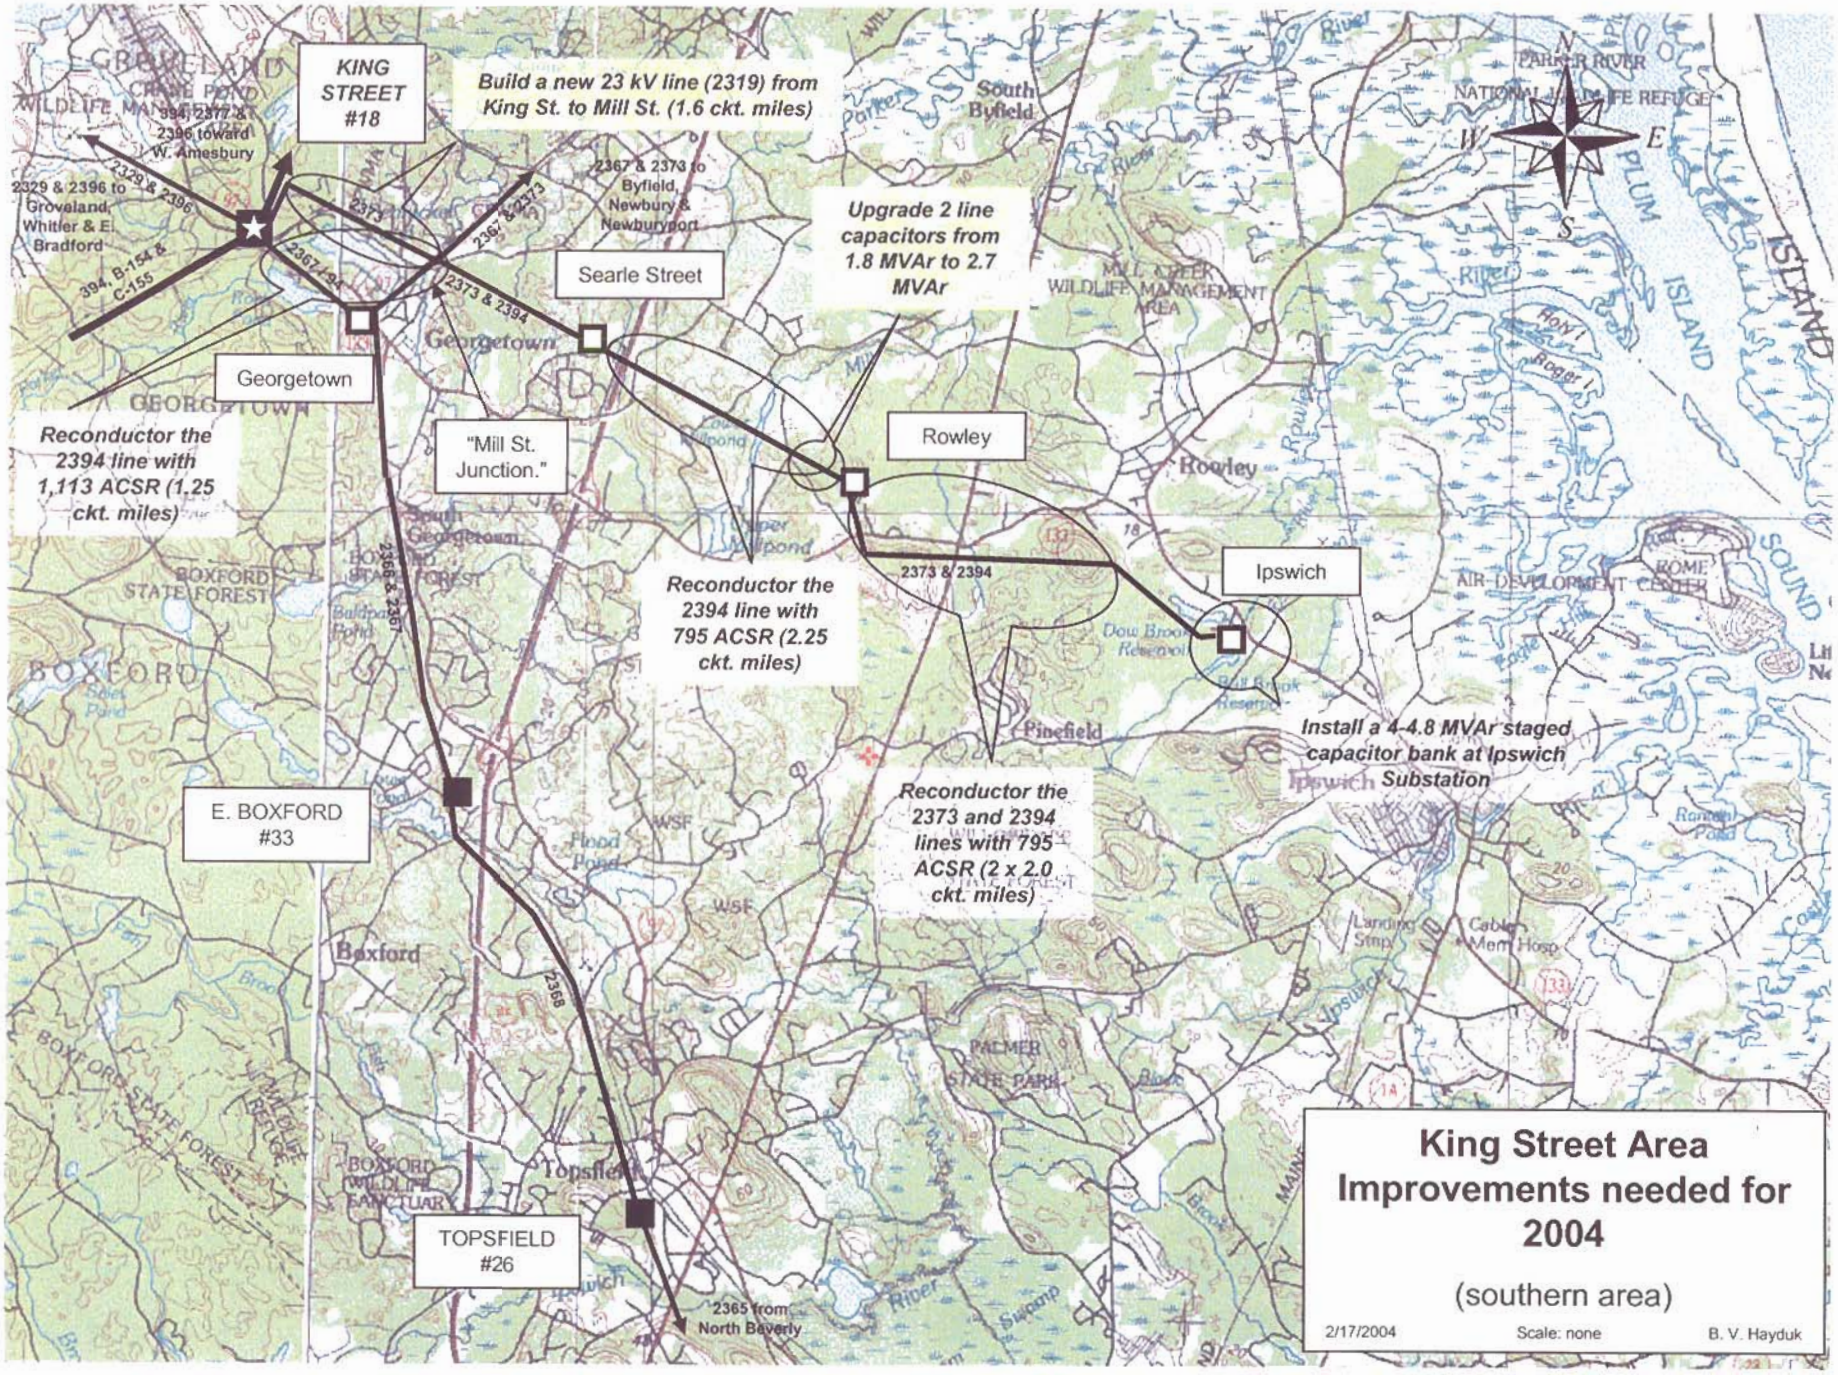
KING STREET #18
Build a new 23 kV line (2319) from King St. to Mill St. (1.6 ckt. miles)
394, 2377 & 2396 toward W. Amesbury
2329 & 2396 to Groveland, Whitler & E. Bradford
2329 & 2396
394, B-154 & C-155
2367 & 2373 to Byfield, Newbury & Newburyport
2367 & 2373
2373
2367 / 94
2373 & 2394
Searle Street
Upgrade 2 line capacitors from 1.8 MVAr to 2.7 MVAr
Georgetown
Reconductor the 2394 line with 1,113 ACSR (1.25 ckt. miles)
"Mill St. Junction."
Rowley
Ipswich
2373 & 2394
Reconductor the 2394 line with 795 ACSR (2.25 ckt. miles)
Install a 4-4.8 MVAr staged capacitor bank at Ipswich Substation
Reconductor the 2373 and 2394 lines with 795 ACSR (2 x 2.0 ckt. miles)
E. BOXFORD #33
2368 & 2367
2368
TOPSFIELD #26
2365 from North Beverly
King Street Area Improvements needed for 2004
(southern area)
2/17/2004
Scale: none
B. V. Hayduk