Q-V CURVE ANALYSIS

QV Curves at Salem Harbor 115 kV, No Salem Gen, Ward Hill T3&T4

* DENOTES CASE DID NOT CONVERGE

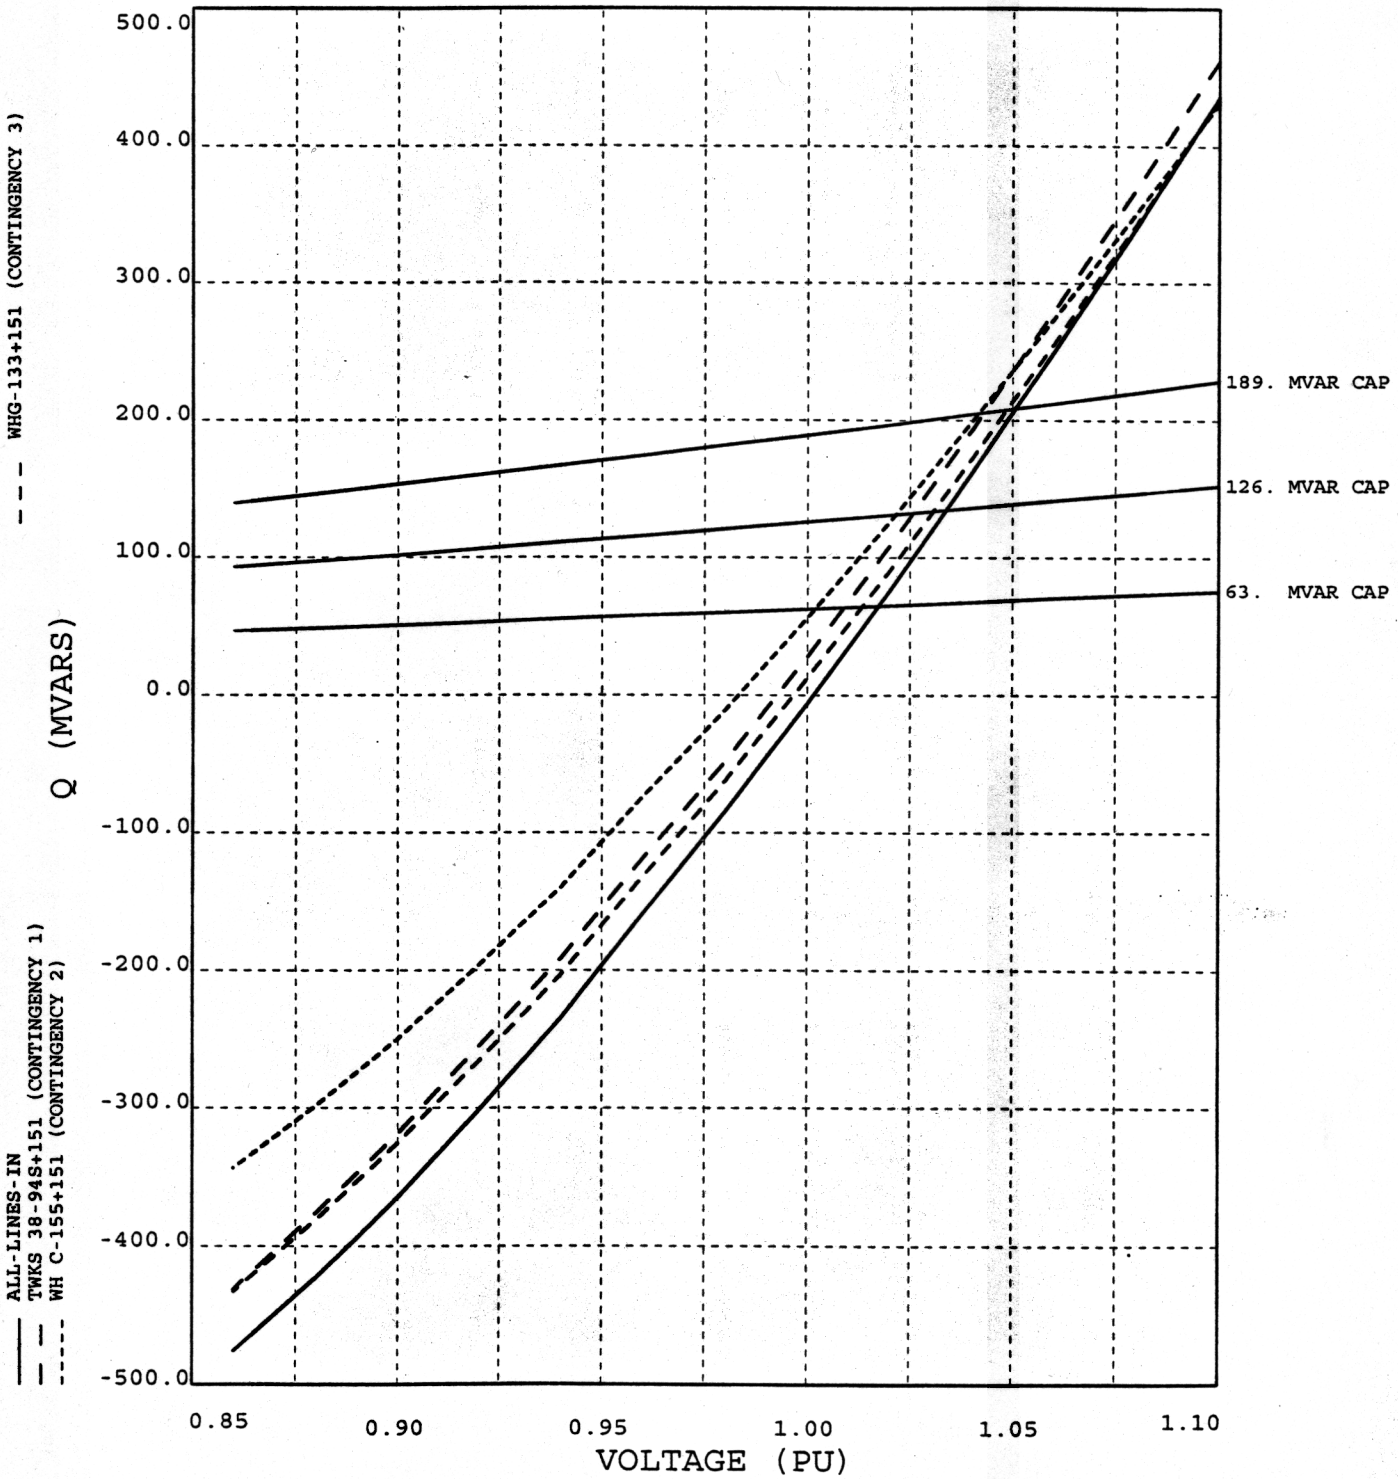

CONTROL BUS = 71891 SALEM HR 115