

527 CMR: BOARD OF FIRE PREVENTION REGULATIONS

527 CMR 12.00: MASSACHUSETTS ELECTRICAL CODE
(AMENDMENTS)

The Massachusetts Electrical Code (527 CMR 12.00) of the Board of Fire Prevention Regulations shall be the 2011 National Electrical Code, (National Fire Prevention Association) NFPA- 70 (2011 Edition) modified as follows:

Insert the following provisions ahead of the body of the Code:

- Rule 1. All installations, repairs and maintenance of electrical wiring and electrical fixtures used for light, heat, power, signaling and communications purposes in buildings and structures subject to the provisions of M.G.L. c. 143 shall be reasonably safe to persons and property.
- Rule 2. Conformity of installations, repairs, and maintenance of electrical wiring and electrical fixtures used for light, heat, power, signaling and communications with applicable regulations set forth in the Code, which is hereby filed with the Secretary of the Commonwealth shall be considered as complying with these requirements.
- Rule 3. Additions or modifications to an existing installation shall be made in accordance with this Code without bringing the remaining part of the installation into compliance with the requirements of this Code. The installation shall not create a violation of this Code, nor shall it increase the magnitude of an existing violation.
- Rule 4. Where an actual hazard exists, the owner of the property shall be notified in writing by the authority enforcing this Code. The notification shall contain specifications of the actual hazard that exists, together with a reference to the rule of this Code that is now in violation. (*See* M.G.L. c. 166, §§ 32 and 33, for enforcement authority.)
- Rule 5. References are made in this code to other standards. Those standards, where duly adopted by law or regulation, may be enforced by the appropriate official. They are not considered part of this Code and they are not enforceable under M.G.L. c. 143 § 3L. For Massachusetts Building Code references, *see* Appendix A.
- Rule 6. The approving authority may be guided in his approval of specific items of equipment and materials contemplated by the Code, by proof that such equipment and materials have been tested and conform to suitable recognized industry standards.
- Rule 7. 527 CMR 12.00 shall be effective on all installations for which a permit has been granted subsequent to December 31, 2010. For installations governed by permits issued after November 1, 2010 and before January 1, 2011, the applicable code shall be the version of 527 CMR 12.00 in effect on November 1, 2010.
- Rule 8. In accordance with the provisions of M.G.L. c. 143, § 3L, the permit application form to provide notice of installation of wiring shall be uniform throughout the Commonwealth, and applications shall be filed on the prescribed form. After a permit application has been accepted by an Inspector of Wires appointed pursuant to M.G.L. c. 166, § 32, an electrical permit shall be issued to the person, firm or corporation stated on the permit application. Such entity shall be responsible for the notification of completion of the work as required in M.G.L. c. 143, § 3L.
- Permits shall be limited as to the time of ongoing construction activity, and may be deemed by the Inspector of Wires abandoned and invalid if he or she has determined that the authorized work has not commenced or has not progressed during the preceding 12-month period. Upon written application, an extension of time for completion of work shall be permitted for reasonable cause. A permit shall be terminated upon the written request of either the owner or the installing entity stated on the permit application.
- Rule 9. Installations covered by 527 CMR 12.00 shall also comply with M.G.L. c. 141.

527 CMR: BOARD OF FIRE PREVENTION REGULATIONS

12.00: continued

Rule 10. Electrical installations shall not be concealed or covered from view until inspected by the inspector of wires within and not more than 24 hours for exterior excavations nor more than 72 hours for interior installations after proper notice to the inspector, Saturdays, Sundays, and holidays excluded.

90.2(B)(5). Delete (d) and revise (c) to read as follows:

(c) Are located in legally established easements, rights-of-way, or by other agreements either designated by or recognized by the public service commissions, utility commissions, or other regulatory agencies having jurisdiction for such installations.

90.4. Revise the first paragraph to read as follows:

90.4 Enforcement. This Code shall be used by the authority enforcing the Code and exercising legal jurisdiction over electrical installations. The authority having jurisdiction of enforcement of the Code shall accept listed and labeled equipment or materials where used or installed in accordance with instructions included with the listing or labeling. The authority shall have the responsibility for deciding upon the approval of unlisted or unlabeled equipment and materials, and for granting the special permission contemplated in a number of the rules.

90.6. Revise to read as follows:

90.6 Interpretations and Appeals. To promote uniformity of interpretation and application of the provisions of this Code, interpretations may be requested from the Board of Fire Prevention Regulations. Requests for interpretation shall be in the form of a question that can receive a "Yes" or "No" answer. This in no way supersedes the right of any individual who is aggrieved by the decision of an Inspector of Wires to appeal from that decision to the Board of Electricians' Appeals in accordance with M.G.L. c. 143, § 3P. The Board of Fire Prevention Regulations shall, upon the request of the Board of Electricians' Appeals, render interpretations to the Board of Electricians' Appeals.

It is customary to revise this Code periodically to conform with developments in the art and the result of experience, and the current edition of the Code shall always be used.

90.10. Add new section numbered 90.10 to read:

90.10. References to Commonwealth of Massachusetts Codes, Regulations, and Laws. References are included in Appendix A for Building Codes, Elevator Regulations, Plumbing and Fuel Gas Code, Board of Fire Prevention Regulations, Division of Industrial Safety, State Sanitary Code, Architectural Barriers Regulations, Permit Applications, and Chapters of the General Laws. *See Appendix A.*

Article 100, Structure. Revise the definition to read as follows:

A combination of materials assembled or located at a fixed location to give support or shelter.

110.14(A). Delete the last sentence of the first paragraph and insert the following two sentences in its place:

Connection by means of wire binding screws or studs and nuts having upturned lugs or equivalent shall be permitted for 10 AWG or smaller solid conductors. Where stranded conductors are terminated on and not looped through such terminals, the terminals shall be identified for such use, or the strands at the terminals shall be made solid.

110.24. Delete this requirement.

110.26(A)(1). Add a fourth paragraph (d) as follows:

(d) Adequate Accessibility. By special permission, smaller spaces may be permitted where it is judged that the particular arrangement of the installation will provide adequate accessibility.

527 CMR: BOARD OF FIRE PREVENTION REGULATIONS

12.00: continued

200.7(C). Delete the final sentence of (1), designate (2) as (3), and insert a new (2) as follows:

(2) If used for single-pole, 3-way or 4-way switch loops, the conductor with white or gray insulation or three continuous white stripes shall be used only for the supply to the switch but not as a return conductor from the switch to the outlet. In these applications reidentification of the conductor with white or gray insulation or with three continuous white stripes shall not be required.

210.8(A)(7). Revise to read as follows:

(7) Sinks - for other than kitchens as covered in 210.8(A)(6), where receptacles are installed within 1.8 m (6 feet), measured horizontally, of the outside edge of the sink.

210.8(B)(5). Revise to read as follows:

(5) Sinks - where receptacles are installed within 1.8 m (6 feet), measured horizontally, of the outside edge of the sink.

210.25(B). Add an exception as follows:

Exception: Branch circuits supplying lighting outlets in common areas on the same floor as a dwelling unit in a new or existing two-family or an existing three-family building shall be permitted to be supplied from equipment that supplies one or more of those dwelling units.

210.52(E). Revise this material to read as follows:

(E) Outdoor Outlets. Outdoor receptacle outlets shall be installed in accordance with (E)(1) through (E)(3). [See 210.8(A)(3).]

(1) One-family and Two-family Dwellings. For a one-family dwelling and each unit of a two-family dwelling that is at grade level, at least one receptacle outlet readily accessible from grade and not more than 2.0 m (6½ feet) above grade level shall be installed at the front and back of the dwelling.

(2) Multifamily Dwellings. For each dwelling unit of a multifamily dwelling where the dwelling unit is located at grade level and provided with individual exterior entrance/egress, at least one receptacle outlet readily accessible from grade and not more than 2.0 m (6½ feet) above grade level shall be installed.

(3) Balconies, Decks and Porches. Balconies, decks and porches that are attached to the dwelling unit and are accessible from inside the dwelling shall have at least one receptacle outlet installed accessible from the balcony, deck or porch. The receptacle shall not be located more than 2.0 m (6½ feet) above the balcony, deck, or porch surface.

210.70(D). Insert an additional lettered subsection (D) to 210.70 as follows:

(D) GFCI Protection of Lighting Outlets in All Occupancies. The operation of a single GFCI device shall not deenergize all lighting outlets in a given area.

220.12. Revise the listed items in Table 220.12 as follows:

<u>Type of Occupancy</u>	Unit Load	
	Volt - Amperes per <u>Square Meter</u>	Volt - Amperes per <u>Square Foot</u>
Banks	28 ^b (reduced from 39)	2½ ^b (reduced from 3½)
Garages-commercial (storage)	3 (reduced from 6)	¼ (reduced from ½)
Office Buildings	33 ^b (reduced from 39)	3 ^b (reduced from 3½)
Warehouses (storage)	6 (increased from 3)	½ (increased from ¼)

12.00: continued

225.30(E). Revise to read as follows:

(E) Documented Switching Procedures. Additional feeders or branch circuits shall be permitted to supply large capacity multibuilding industrial or institutional installations under single management where documented safe switching procedures are established and maintained for disconnection.

225.32 Exception No. 1. Revise to read as follows:

Exception No. 1: For large capacity multibuilding industrial or institutional installations under single management where documented safe switching procedures are established and maintained for disconnection, and where the disconnection is monitored by qualified individuals, the disconnecting means shall be permitted to be located elsewhere on the premises.

225.36. Delete the exception, and revise this section to read as follows:

Type. The disconnecting means specified in 225.31 shall be comprised of a circuit breaker, molded case switch, general use switch, snap switch, or other approved means. Where applied in accordance with 250.32(B) Exception, the disconnecting means shall be suitable for use as service equipment.

225.38. Delete the exception.

230.6(5). Revise this item to read as follows:

(5) Where installed within rigid metal conduit (Type RMC) or intermediate metal conduit (Type IMC) used to accommodate the clearance requirements in 230.24 and routed directly through an eave but not a wall of a building.

230.70(A)(1). Add the following sentence at the end of this paragraph:

Where the location of the service disconnecting means is outside of and not attached to the building or structure served, a feeder disconnect shall be installed either inside or outside of the building or structure in compliance with the provisions of 225.32.

230.82. Revise this section to read as follows:

230.82. Equipment Connected to the Supply Side of Service Disconnect. Only equipment included in this section shall be permitted to be connected to the supply side of the service disconnecting means.

(A) Supply Side Equipment.

- (1) Cable limiters or other current limiting devices.
- (2) Meters or meter sockets nominally rated not in excess of 600 volts, provided all metal housings and service enclosures are grounded in accordance with Part VII and bonded in accordance with Part V of Article 250.
- (3) Instrument transformers (current and voltage), high-impedance shunts, load management devices, surge arresters, and Type 1 surge-protective devices.
- (4) Connections used only to supply load management devices, circuits for standby power systems, fire pump equipment, and fire and sprinkler alarms, if provided with service equipment and installed in accordance with requirements for service-entrance conductors.
- (5) Solar photovoltaic systems, fuel cell systems, or interconnected electric power production sources.
- (6) Control circuits for power-operable service disconnecting means, if suitable overcurrent protection and disconnecting means are provided.
- (7) Ground-fault protection systems or Type 2 surge protective devices, where installed as part of listed equipment, if suitable overcurrent protection and disconnecting means are provided.

12.00: continued

(8) Connections used only to supply listed communications equipment under the exclusive control of the serving electric utility, if suitable overcurrent protection and disconnecting means are provided. For installations of equipment by the serving electric utility, a disconnecting means is not required if the supply is installed as part of a meter socket such that access can only be gained with the meter removed.

(B) Meter Disconnect Switches. A disconnecting means shall be permitted to be located ahead of the service equipment provided the installation complies with 230.82(B)(1) through 230.82(B)(3). A separate service disconnecting means that complies with Part V of Article 230 shall be installed, and shall be located as provided in 230.70(A)(1).

(1) Rating. A meter disconnect shall be capable of interrupting the load served. It shall have a short-circuit current rating not less than the available short-circuit current.

(2) Marking. A meter disconnect shall be legibly field marked on its exterior in a manner suitable for the environment substantially as follows:

METER DISCONNECT
NOT SERVICE EQUIPMENT

Informational Note: This rule does not specify whether the meter disconnect is on the line or load side of the meter because either side is acceptable and will be governed by the policies of the serving utility.

(3) Grounding. A meter disconnect shall be grounded in accordance with Part VII and bonded in accordance with Part V of Article 250. The grounding connections shall be permitted to be in accordance with 250.142(A)(1).

250.52(A)(3). Add an informational note as follows:

Informational Note: These electrodes, where available due to the footings not yet having been poured, are usually far lower in impedance than rod, pipe, or plate electrodes.

250.130(C). Delete this subsection.

300.4(D). Delete this subsection.

300.5(A). Add an informational note to this subsection as follows:

Informational Note: Cables suitable for direct burial are often sleeved in various raceways for design reasons. If such cable is installed with sufficient cover for direct burial, then the characteristics of that raceway need not be evaluated. Other rules of this Code that apply to raceways generally may apply. *See* 300.5(H).

300.5(D)(3). Revise this paragraph to read as follows:

(3) Service Conductors. Underground service conductors and service raceways that are not encased in concrete and that are buried 450 mm (18 inches) or more below grade shall have their location identified by a warning ribbon that is placed in the trench at least 300 mm (12 inches) above the underground installation.

300.11(A). Revise this subsection as follows:

I. Delete the third sentence in 300.11(A) which reads: "Support wires and associated fittings that provide secure support and that are installed in addition to the ceiling grid support wires shall be permitted as the sole support."

II. Revise 300.11(A)(2) to read as follows:

(2) Nonfire-rated Assemblies. Branch-circuit wiring associated with equipment that is located within, supported by, or secured to a suspended ceiling that is not an integral portion of a fire-rated floor/ceiling or roof/ceiling assembly shall be permitted to be supported by the ceiling support wires.

527 CMR: BOARD OF FIRE PREVENTION REGULATIONS

12.00: continued

III. Delete 300.11(A)(2) Exception.

300.17. Add a second paragraph as follows:

Where different raceway wiring methods are joined together without a pull point at the transition, there shall not be more than the equivalent of four quarter bends (360° total) between pull points, e.g., conduit bodies and boxes.

300.37. Insert the following sentence following the first sentence:

Where rigid nonmetallic conduit is used, it shall be Schedule 80 or it shall be suitably encased in not less than 50 mm (2 inches) of concrete.

300.50. In Note 3 to Table 300.50, insert the words "or institutional" after the word "industrial".

310.15(B)(3)(a). Delete the fourth itemized adjustment provision.

310.15(B)(3)(a). Revise Table 310.15(B)(3)(a) to read as follows:

<u>Number of Conductors¹</u>	<u>Percent of Values in Tables 310.15(B)(16) through 310.15(B)(19), as Adjusted for Ambient Temperature if Necessary</u>
4 through 6	80
7 through 24	70
25 through 42	60
43 and above	50

¹ Number of Conductors is the total number of conductors in the raceway or cable adjusted in accordance with 310.15(B)(5) and (6)

Informational Note: Overheating may occur where continuous, fully loaded conductor diversity is less than 50% and the number of current-carrying conductors exceeds nine. See 310.15(A)(3).

314.15. Revise this section by inserting the following sentence between the first and second sentences of the NEC text: "Drainage openings not larger than 6 mm (¼ inch) shall be permitted to be installed in the field."

320.80(A). Delete the last sentence, which reads: "The 90°C (194°F) rating shall be permitted to be used for ampacity adjustment and correction calculations; however, the ampacity shall not exceed that for a 60°C (140°F) rated conductor."

334.10. Insert an exception after (3) to read as follows:

Exception to (2) and (3): For buildings or structures required to be of Type I or Type II construction, Type NM, Type NMC, and Type NMS cables shall be permitted to be used, provided that where so applied in buildings or structures exceeding three stories above grade, circuits run in Type NM, NMC, or NMS cable shall not leave the floor or dwelling unit from which the circuits originate.

334.12(A)(2). Revise to read as follows:

(2) In dropped or suspended ceilings in other than one- and two-family and multifamily dwellings, unless run so as to closely follow the surface of framing members, running boards, or the equivalent, or unless connected to luminaires or other pieces of electrical equipment in accordance with 334.30(B)(2).

12.00: continued

334.17. Revise to read as follows:

334.17 Through or Parallel to Framing Members and Furring Strips. Types NM, NMC, or NMS cable shall comply with 300.4 where installed through studs, joists, rafters, and similar members. Grommets or bushings shall be used in metal studs as required in 300.4(B)(1), shall remain in place during the wall finishing process, shall cover the complete opening, and shall be listed for the purpose of cable protection.

In both exposed and concealed locations, where the cable is installed parallel to framing members, such as joists, rafters, or studs, or is installed parallel to furring strips, the cable shall be secured so that the nearest outside surface of the cable is not less than 19 mm ($\frac{3}{4}$ inch) from the nearest edge of the framing member or furring strip where nails or screws are likely to penetrate. Where this distance cannot be maintained, the cable shall be protected from penetration by nails or screws by a steel plate, sleeve, or equivalent at least 1.6 mm (1/16 inch) thick. A listed and marked steel plate less than 1.6 mm (1/16 inch) thick that provides equal or better protection against nail or screw penetration shall be permitted for this purpose.

Exception: For concealed work in finished buildings, or finished panels for prefabricated buildings where such supporting is impracticable, it shall be permitted to fish the cable between access points.

334.30. Revise 334.30 as follows [(A), (B), and (C) unchanged from the NEC]:

334.30 Securing and Supporting. Nonmetallic-sheathed cable shall be secured by staples, cable ties, straps, or similar fittings so designed and installed as to not damage the cable. Where staples are used for cable sizes smaller than three 8 AWG conductors, they shall be of the insulated type, or listed noninsulated staples driven by staple guns shall be permitted. Cable shall be secured in place at intervals not exceeding 1.4 m (4½ feet) and within 300 mm (12 inches) from every cabinet, box, or fitting. Where the cable is run diagonally behind strapping of a nominal 19 mm ($\frac{3}{4}$ inch) thickness it shall be considered supported, secured, and in compliance with 334.17 where it is not pulled taut. For other than within 300 mm (12 inches) of a cable termination at a cabinet, box, or fitting, cables passing through successive holes in adjacent framing members no more than 600 mm (24 inches) apart shall be considered to be secured.

Sections of cable protected from physical damage by raceway shall not be required to be secured within the raceway.

334.80. Delete the second paragraph and revise the first paragraph to read as follows:

334.80 Ampacity. Type NM, NMC, and NMS cable shall have conductors rated at 90°C (194°F). Where installed in thermal insulation, the ampacity of conductors shall be that of 60°C (140°F) conductors. The ampacity of Types NM, NMC, and NMS cable installed in cable tray shall be determined in accordance with 392.11.

338.10(B)(4)(a). Identify the existing informational note as Informational Note No. 1, and add a second informational note as follows:

Informational Note No. 2: This section includes service entrance cables with a round configuration commonly known as SER cable. The interior installation of this cable is governed by the same rules as apply to nonmetallic sheathed cable.

344.6. Add an exception as follows:

Exception: Rigid metal conduit made from stainless steel or from nonferrous metals other than aluminum shall be permitted to be approved.

352.12. Add a new (F) to read as follows:

(F) High-rise Buildings. Where used in buildings more than 21 m (70 feet) above mean grade, rigid nonmetallic conduit shall not be used unless the building is protected by an approved fire sprinkler system(s) installed on all floors as a complete system, or the conduit is concealed behind a thermal barrier as described in 362.10(2) or 362.10(5), or the conduit is encased in not less than 50 mm (2 inches) of concrete.

12.00: continued

368.8. Insert a new Section 368.8 in Part I of Article 368 as follows:

368.8 Tests Prior to Energizing. Busway system joint tightness and joint resistance, phasing, and insulation resistance shall be verified by test prior to energizing the system for the first time. A written record of these tests shall be made available to the authority having jurisdiction.

368.14. Insert a new Section 368.14 in Part II of Article 368 as follows:

368.14 Protection from Liquids, Moisture and Other Contaminants. Busway shall be protected from liquids, moisture, and other contaminants or corrosion that may result in electrical failure.

(A) During Construction. Indoor busways shall be protected from moisture during storage as well as during or after installation. Special consideration shall be given to riser busways to protect them from moisture from uncompleted roofs, walls, *etc.*

Outdoor busways shall be treated the same as indoor busways until after busway is properly installed, as it is not weather resistant until completely and properly installed.

Busway shall have the exposed ends of uncompleted runs protected to prevent accidental contamination during the construction period.

(B) Protection from Snow Buildup. Outdoor busway shall be mounted in such a manner as to prevent snow or ice buildup forcing water into the busway through weep holes. This may require that consideration be given to horizontal snow or ice buildup or drifting of snow.

(C) Protection from Falling Liquids. Slant shields, drip pans, or other approved protective shields shall be installed to protect indoor busway in locations where there is a possibility of water spillage or dripping condensate from roof drains, water pipes, and the like.

368.56(B). Revise the rule in list item (2) and the exception to (B)(2) to read as follows:

(2) The length of the cord or cable from a busway plug-in device to a suitable tension take-up support device shall not exceed 2.5 m (8 feet).

Exception to (B)(2): By special permission in industrial establishments only, where the conditions of maintenance and supervision ensure that only qualified persons will service the installation, flexible cord suitable for hard usage or extra hard usage or bus drop cable shall be permitted to extend horizontally greater lengths than 2.5 m (8 feet) where the longer length is essential for periodic repositioning of equipment. The flexible cord or bus drop cable shall be supported at intervals not to exceed 2.5 m (8 feet), and suitable tension take-up device(s) shall be installed at the end of the horizontal run to relieve strain in both the horizontal and vertical directions.

372.17. Revise this section to read as follows:

372.17 Ampacity of Conductors. The ampacity adjustment factors in 310.15(B)(3)(a) shall not apply where 30 or fewer current-carrying conductors occupy no more than 20% of the interior cross-sectional area of cellular concrete floor raceways.

374.17. Revise this section to read as follows:

374.17 Ampacity of Conductors. The ampacity adjustment factors in 310.15(B)(3)(a) shall not apply where 30 or fewer current-carrying conductors occupy no more than 20% of the interior cross-sectional area of cellular metal floor raceways.

390.17. Revise this section to read as follows:

390.17 Ampacity of Conductors. The ampacity adjustment factors in 310.15(B)(3)(a) shall not apply where 30 or fewer current-carrying conductors occupy no more than 20% of the interior cross-sectional area of underfloor raceways.

527 CMR: BOARD OF FIRE PREVENTION REGULATIONS

12.00: continued

400.5. Revise Table 400.5(A)(3) to read as follows:

<u>Number of Conductors</u>	<u>Percent of Values in Tables 400-5(A) and 400-5(B)</u>
4 through 6	80
7 through 24	70
25 through 42	60
43 and above	50

Informational Note: Overheating may occur where continuous, fully loaded conductor diversity is less than 50% and the number of current-carrying conductors exceeds nine. See 310.15(A)(3).

400.8(4). Revise the existing exception as follows:

Exception to (4): Flexible cord and cable shall be permitted to be installed in accordance with 368.8(B). For other applications, where the length of the cord from the supply termination to a suitable tension take-up device is limited to 2.5 m (8 feet), flexible cord shall be permitted to have one connection to the building surface.

400.14. Revise the second paragraph to read as follows:

Flexible cords and cables shall be permitted to be installed in raceways not longer than 15 m (50 feet) in length where required to protect the flexible cord or cable from physical damage. The ampacity of the conductors within a raceway shall be adjusted in accordance with Table 400.5 based on the total number of current-carrying conductors within the raceway, and then further derated by a factor of 0.8, or the ampacity shall be calculated in accordance with 310.15(C). The raceway shall be exposed over its entire length.

404.2(C). Designate the exception as "Exception No. 1" and insert an additional exception as follows:

Exception No. 2: Where multiple switch locations control the same lighting load in an interior room or space, a grounded conductor of the lighting circuit shall not be required at each such location if one has been provided at one or more switching points that is (are) visible from most areas within the room including all principal entry points. Where a switch controls a receptacle load or lighting load that does not serve a habitable room or bathroom, or where automatic control of lighting has been provided or the switch is not within the lit area, a grounded circuit conductor shall not be required.

410.36(B). Add a second paragraph as follows:

In addition to, or in *lieu* of, the mechanical fastening means, electric luminaires containing ballasts, other than simple fluorescent reactance ballasts, shall be supported directly to the building structure by wire, chain, or threaded rod of sufficient strength to carry the luminaire. Fluorescent luminaires shall be supported at each end of a diagonal axis of the luminaire.

517.13(B)(1). Delete Exception No. 2 to (3).

550.2 Manufactured Home, Informational Note No. 2. Add the following sentence:

Manufactured housing that is not designed to be transportable on running gear, and that is not produced under regulations that expressly cover such housing, is classified under Article 545.

12.00: continued

680.7. Insert an informational note ahead of 680.7(A) as follows:

Informational Note: Unlisted swimming pool pump motors have been observed in the field as having been supplied by their manufacturer with undersized cords, cords of excessive length, cord connectors on outdoor applications that are unsuitable for wet locations, and other violations of this Code. The fact that a manufacturer may supply them in this form does not excuse compliance with the rules of this Code.

Listed storable swimming pool pump motors with long factory-supplied cords are prominently marked as such and are not covered in Part II of Article 680. They are not manufactured for use with permanently installed pools and they need not be bonded where used as intended. *See* 680.31.

680.26(C). Revise to read as follows:

(C) Pool Water. Pool water shall have an electrical connection to one or more of the bonded parts described in 680.26(B). Where none of the bonded parts is in direct connection with the pool water, the pool water shall be in direct contact with an approved corrosion-resistant conductive surface that exposes not less than 5800 mm² (9 inches²) of surface area to the pool water at all times. The conductive surface shall be located where it is not exposed to physical damage or dislodgement during usual pool activities, and it shall be bonded in accordance with 680.26(B).

690.11. Insert the following note following the fourth list item::

This requirement shall take effect on January 1, 2014.

695.3. Insert an informational note ahead of 695.3(A) as follows:

Informational Note: NFPA 20-2010, Standard for the Installation of Stationary Pumps for Fire Protection, provides information on the characteristics of reliable power sources in Appendix A, item A-9.3.2.

700.10. Make the following two revisions:

I. Revise (D) to read as follows: Emergency Systems shall meet the additional requirements in (D)(1) through (D)(3).

II. Revised (D)(1) by deleting (1) and renumber (2) through (5) as (1) through (4) respectively.

700.12. Add an exception after the first paragraph as follows:

Exception: A fire pump shall be permitted to use a connection ahead of the service disconnecting means in accordance with 695.3(A)(1).

700.12(F). Delete the second sentence of the second paragraph that reads:

Flexible cord- and plug-connection shall be permitted provided that the cord does not exceed 900 mm (3 feet) in length.

701.12(G). Delete the second sentence of the second paragraph which reads:

Flexible cord- and plug-connection shall be permitted provided that the cord does not exceed 900 mm (3 feet) in length.

527 CMR: BOARD OF FIRE PREVENTION REGULATIONS

12.00: continued

702.11. Insert a new 702.11(C) as follows:

(C) Classification of Supply. A generator with a grounded circuit conductor connection as part of its output shall be wired as a separately derived source unless its grounded circuit conductor is not bonded to the frame, or where used to supply a premises wiring system it shall be permitted to be wired as a nonseparately derived source if all of the following conditions are met:

- (1) The generator rating does not exceed 15 kw.
- (2) The generator is connected through a flexible cord and a cord connector to a flanged inlet.
- (3) The flexible cord does not exceed 4.5 m (15 feet) in length.
- (4) The flanged inlet connection point is not more than 3.0 m (10 feet) from the main bonding jumper or system bonding jumper for the supplied premises.
- (5) The point of connection is marked "Disconnect cord when generator is not in service."
- (6) Ground-fault protection of equipment has not been installed on any portion of the premises wiring system supplied by the generator.

Informational Note: Current product standards require all portable generators rated 15 kw and below and supplying grounded output circuits to have the grounded circuit conductor connections bonded to the generator frame.

DIVISION OF INDUSTRIAL SAFETY

454 CMR 10.00: *Construction Industry Rules and Regulations*
Part 17

Tunnels and Shafts, Caissons, Cofferdams, and Compressed Air

- 10.175 Tunnels and Shafts
Section 12 Electrical Equipment
- 10.178 Compressed Air
Section 11 Electricity

ELEVATOR REGULATIONS

524 CMR 15.00 through 35.00

BOARD OF STATE EXAMINERS OF PLUMBERS AND GAS FITTERS

248 CMR 6.00: NATIONAL FUEL GAS CODE (NFPA 54)

- 5.4.3(d): Proper permanent lighting shall be provided at the roof access. The switch for such lighting shall be located inside the building near the access means leading to the roof.

BOARD OF FIRE PREVENTION REGULATIONS

527 CMR 4.00: Oil Burning Equipment

- 4.04: Oil Burners, Light Fuel Oil Type
- (3) Oil Burner Controls
 - (4) Electric Wiring and Equipment

527 CMR 5.00: Operation and maintenance of buildings or other structures used as garages, service stations and the related storage, keeping and use of gasoline or other motor fuel.

- 5.07 Dispensing Equipment
- (2) Heat activated shutoff switch
 - (5) Emergency pump shutoff switches/circuit breakers

527 CMR: BOARD OF FIRE PREVENTION REGULATIONS

12.00: continued

527 CMR 15.00: Keeping, handling and transportation of flammable and combustible liquids, and the disposition of crude petroleum or any of its products in harbors or other waters of the Commonwealth.

15.09 General Provisions [Marinas]

(1) a, b, c. Equipment ratings, emergency shutoffs, permitted wiring locations

APPENDIX A†

Other codes and standards that govern the built environment include provisions that address the performance of electrical systems. These provisions may include support requirements to assure that electrical components will behave as expected during a seismic event, or what components must be included in an existing tenancy as a minimum standard of occupancy, or where emergency shut-off switches must be located for oil burners, or special provisions for elevator disconnects, or where manually activated components must be positioned in occupancies designed for people confined to wheelchairs, *etc.* This appendix is intended to alert users to where such provisions are located in the Code of Massachusetts Regulations (CMR). Appendix A has no mandatory provisions, and as such is not part of the Massachusetts Electrical Code. For this reason some or all of its provisions may be delayed without affecting the effective date of the code itself.

780 CMR: MASSACHUSETTS STATE BUILDING CODE

The seventh edition of the Building Code, although based on a model code, contained the entire text of the code as adopted. For usability this document has been split between a Basic/Commercial version and a One- and Two-family version. The eighth edition of the State Building Code follows the same format, but its components are (with separately stated amendments) taken from the International Building Code 2009 as published by the International Code Council (ICC). Building Code users will need to buy the ICC book, which can be obtained through the ICC at www.iccsafe.org or call 1-888-ICC-SAFE (422-7233). Then a building code user will need to buy the Massachusetts amendments from the State Bookstore, similar to the electrical code procedure.

The Eighth Edition of the Massachusetts Basic/Commercial Building Code has been released and consists of the following: 2009 International Building Code, 2009 International Energy Conservation Code, 2009 International Mechanical Code, and 2009 International Existing Building Code, Massachusetts Amendments and Special Regulations 780 CMR 110.R1 through R7, and other listed Referenced Standards. The One- and Two-family portion of the eighth building code edition should be available in January, 2011, also with separately stated amendments.

†General Footnote to Appendix A: The provisions of the regulations cited in this appendix are noted to assist the users of this Code in properly considering various electrical design constraints of other building systems. They are generally unenforceable by an Inspector of Wires. *See* Rule 5 of this Code.

105 CMR 410.000: MINIMUM STANDARDS OF FITNESS FOR HUMAN HABITATION
(STATE SANITARY CODE, CHAPTER II)

- 410.250: Habitable Rooms Other than Kitchen - Natural Light and Electrical Outlets
- 410.251: Kitchen Lighting and Electrical Outlets
- 410.252: Bathroom Lighting and Electrical Outlets
- 410.253: Light Fixtures Other than in Habitable Rooms or Kitchens
- 410.254: Light in Passageways, Hallways, and Stairways
- 410.255: Amperage
- 410.256: Temporary Wiring
- 410.258: Exemption of Dwellings More than 600 Feet from Electrical Service
- 410.280: Natural and Mechanical Ventilation
- 410.281: Ventilation Shut-off
- 410.354: Metering of Electricity and Gas
- 410.482: Smoke Detectors and Carbon Monoxide Alarms
- 410.483: Auxiliary Emergency Lighting Systems and Exit Signs

12.00: continued

521 CMR: ARCHITECTURAL ACCESS BOARD

39.3: HEIGHT


The highest operable part of controls, dispensers, receptacles, and other operable equipment shall be placed within at least one of the reach ranges specified in 521 CMR 6.5, Forward Reach and 521 CMR 6.6, Side Reach.

39.3.1 Electrical and communications system receptacles on walls shall be mounted between 15 inches (15" = 381mm) and 48 inches (48" = 1219mm) above the floor, measured at the centerline of the lowest receptacle.

Exception: These requirements do not apply where the use of special equipment dictates otherwise or where electrical and communications systems receptacles are not normally intended for use by building occupants.

39.4: LOCATION


All such controls shall be located at least 18 inches (18" = 457mm) from an interior corner.

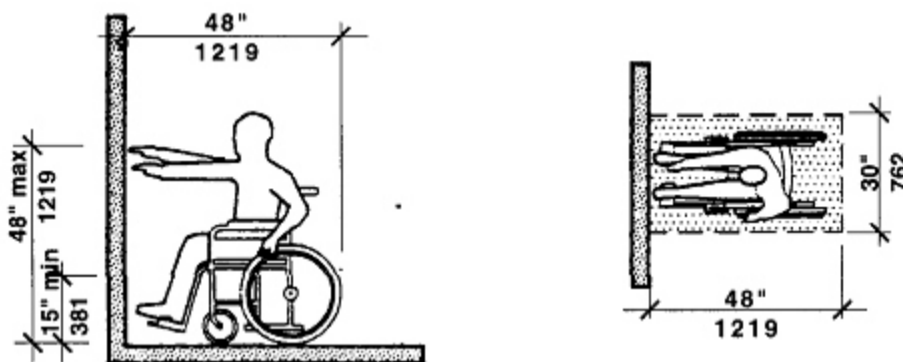

High Forward Reach Limit
Figure 6k

6.5: FORWARD REACH

If the *clear floor* space only allows forward approach to an object, the maximum high forward reach allowed shall be 48 inches (48" = 1219mm) (See Fig. 6k). The minimum low forward reach is 15 inches (15" = 381mm). If the high forward reach is over an obstruction, reach and clearances shall be as shown in Fig. 6l.

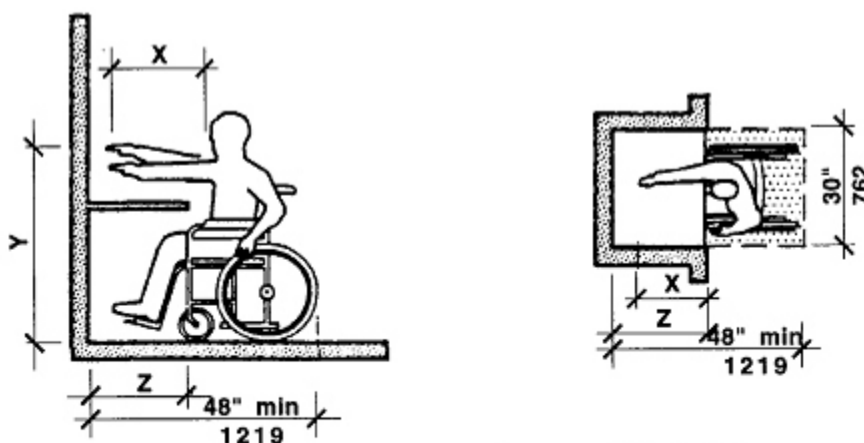


NOTE: X shall be less than or equal to 25" (635 mm). Z shall be greater than X.
When X is less than 20" (508 mm), then Y shall be 48" (1219 mm) max.
When X is 20" to 25" (508 to 635 mm), then Y shall be 44" (1118 mm) max.

Maximum Forward Reach over an Obstruction
Figure 6l

12.00: continued

6.6: SIDE REACH

If the *clear floor* space allows parallel approach by a person in a wheelchair, the maximum high side reach allowed shall be 54 inches (54" = 1372mm) and the low side reach shall be no less than nine inches (9" = 229mm) above the floor (See Fig. 6m). If the side reach is over an obstruction, reach and clearances shall be as shown in Fig. 6n.

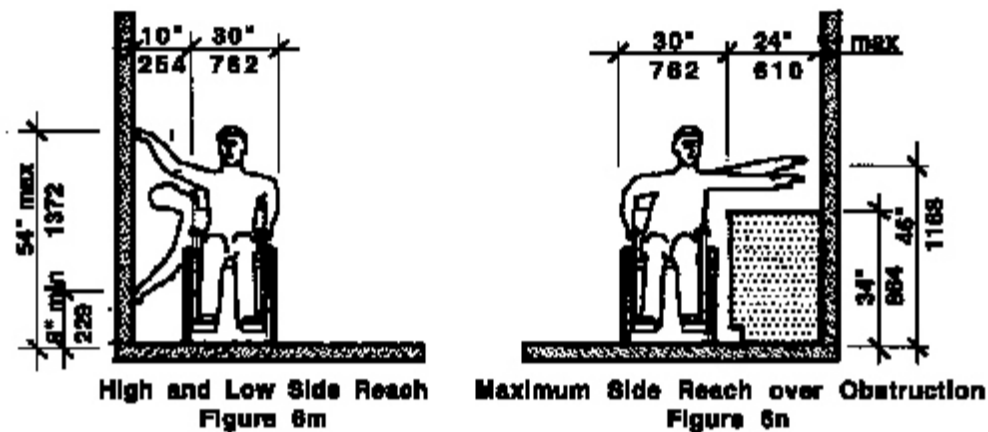

REGULATORY AUTHORITY

527 CMR 12.00: M.G.L. c. 22D, § 4; c. 143, § 3L; c. 148, § 10

(PAGES 151 AND 152 ARE RESERVED FOR FUTURE USE.)