


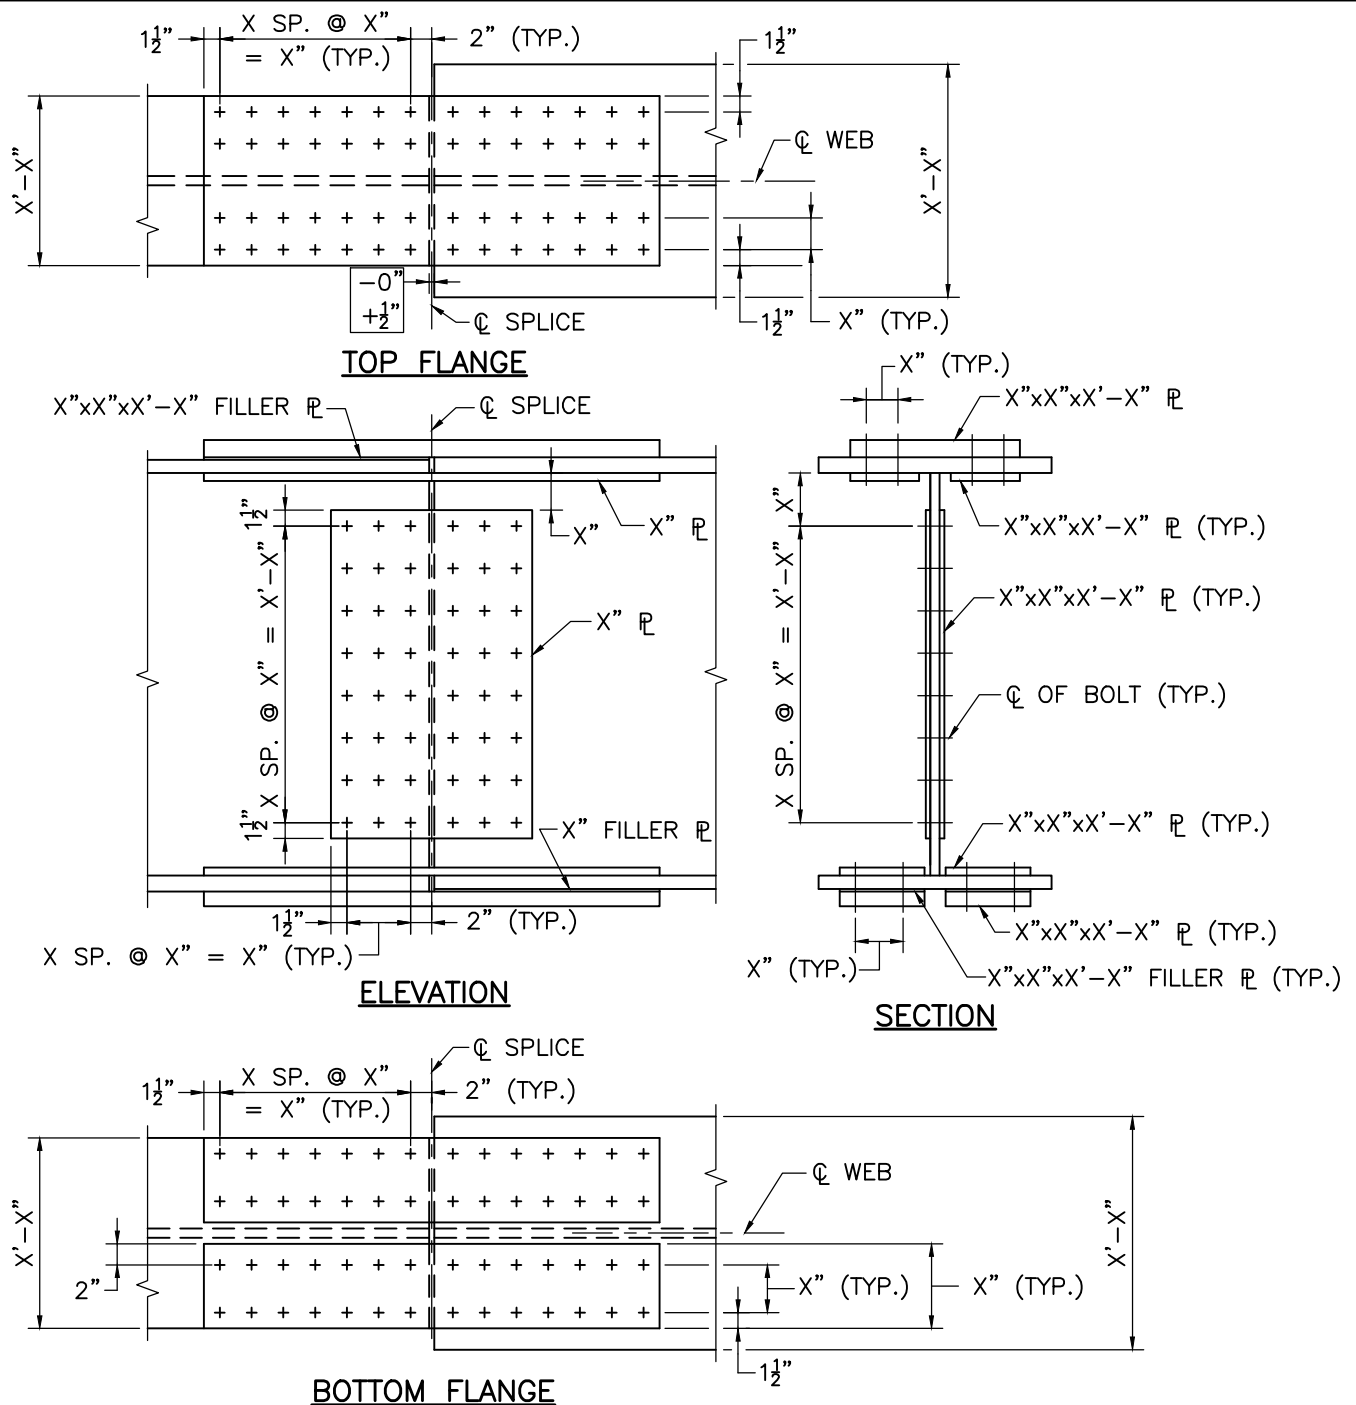

NOTES:

1. BOLTED FIELD SPLICES SHALL BE CONSIDERED SLIP CRITICAL CONNECTIONS WITH CLASS B FAYING SURFACES. (*Change to Class C for galvanized surfaces.*)
2. + DENOTES 7/8" Ø ASTM A325 HIGH STRENGTH BOLT IN 15/16" Ø HOLE.
3. THICKNESS DIFFERENCES OF 1/8" OR LESS DO NOT REQUIRE FILLER PLATES. FILLER PLATES SHALL CONFORM TO AASHTO M 270 GRADE 50W OR ASTM A606. (*Include where required.*)
4. ONE ROW OF STUD SHEAR CONNECTORS SHALL BE PLACED ALONG THE CENTERLINE OF THE TOP FLANGE SPLICE PLATE.

BOLTED FIELD SPLICE DETAILS

SCALE: 1" = 1'-0"