


# Average TN by System for Fuji Clean with Provisional Use Approval for Systems <900 Gallons Per Day

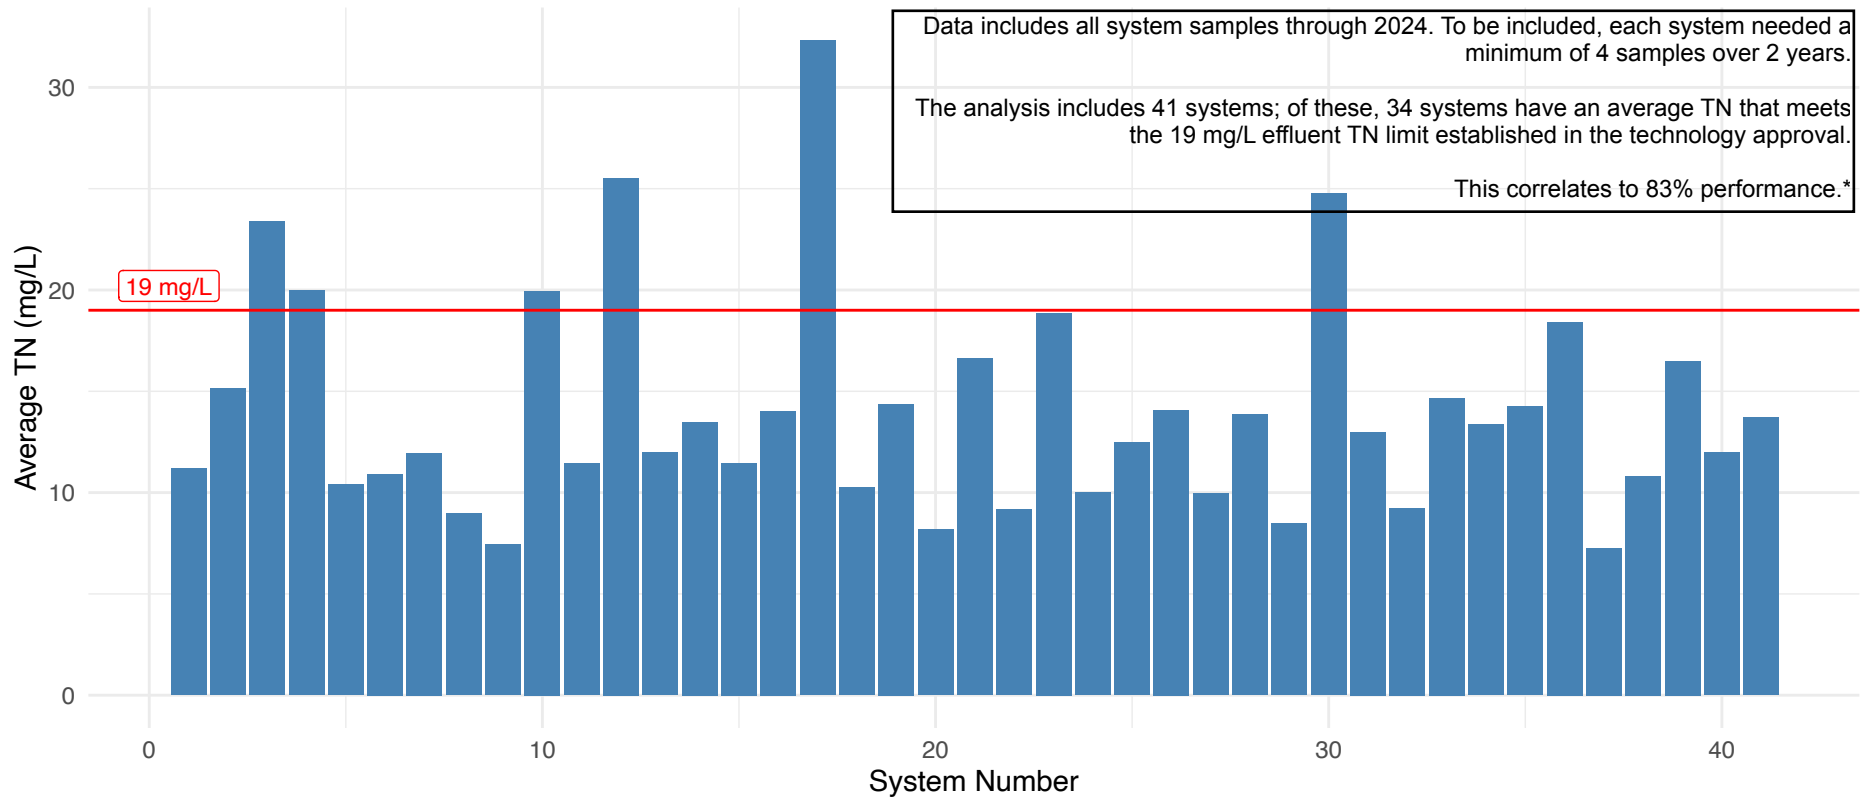

### **\*Notes**

MassDEP reviews performance data for nitrogen reducing technologies approved for use in Massachusetts on a yearly basis to maintain the Best Available Nitrogen Reducing Technology (BANRT) list in accordance with 310 CMR 15.215(2)(g).

In 2024, the Fuji Clean system with Provisional Use approval was not included in the BANRT analysis. In 2025, the BANRT analysis for the Fuji Clean system with Provisional Use approval includes 41 systems with 34 systems that have an average TN meeting the 19 mg/L effluent TN standard established in the technology approval. This correlates to 83% performance.