


Average TN by System for SeptiTech with Provisional Use Approval for Systems <2,000 Gallons Per Day

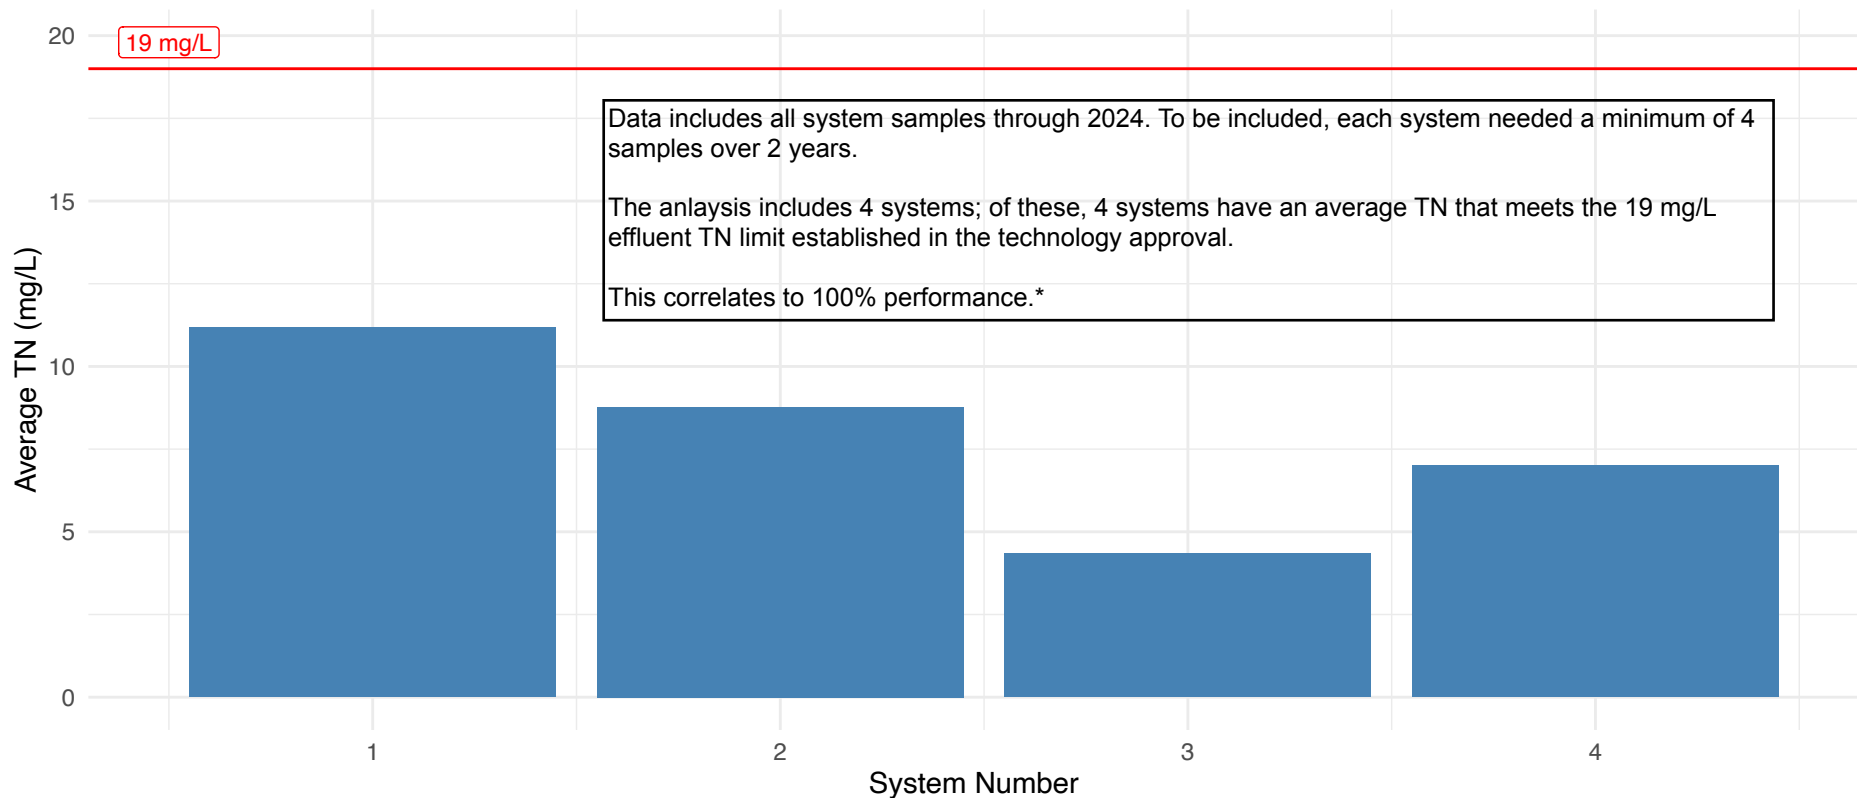

***Notes**

MassDEP reviews performance data for nitrogen reducing technologies approved for use in Massachusetts on a yearly basis to maintain the Best Available Nitrogen Reducing Technology (BANRT) list in accordance with 310 CMR 15.215(2)(g).

In 2024, the SeptiTech system with Provisional Use approval for systems with flows less than 2,000 gallons per day did not have enough data for BANRT analysis.

In 2025, the BANRT analysis for the SeptiTech system with Provisional Use approval for systems with flows less than 2,000 gallons per day includes 4 systems with 4 systems that have an average TN meeting the 25 mg/L effluent TN standard established in the technology approval. This correlates to 100% performance.