


## Monitoring Wells 205 and 206 Tritium Concentrations 2010-15\*\*

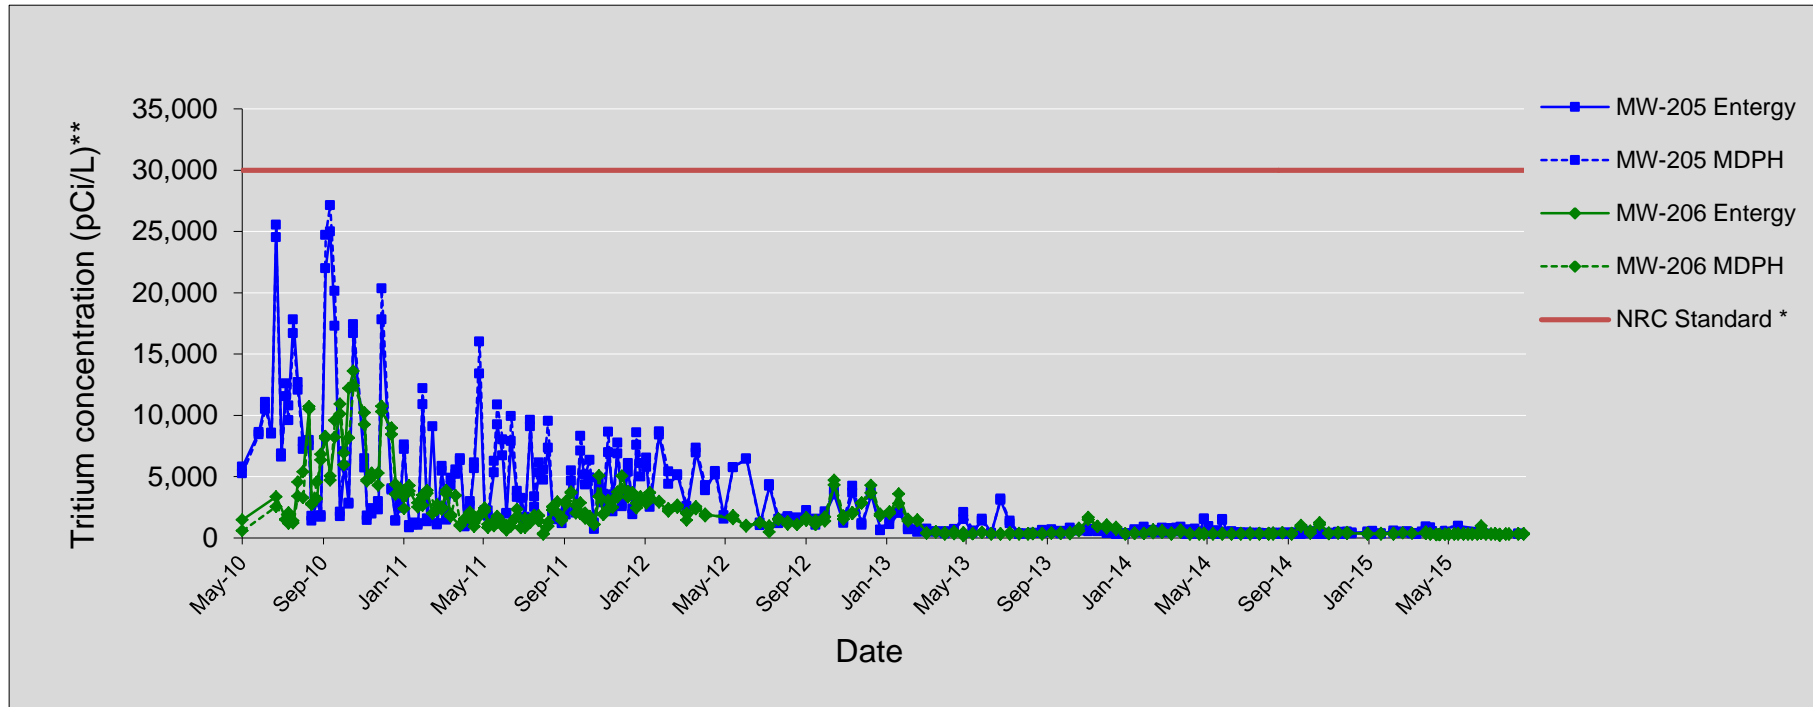

\* The NRC-approved Pilgrim offsite Dose Calculation Manual standard for tritium in non-drinking water sources in 30,000 pCi/L.

\*\* This chart will no longer be updated as the trend in low tritium levels has continued. (Post-2015 results are provided in tables located on this webpage)  
Should results return to pre-September 2013 levels, the chart will be revised.