


Appendix D

Zone I Radius vs. Pumping Rate

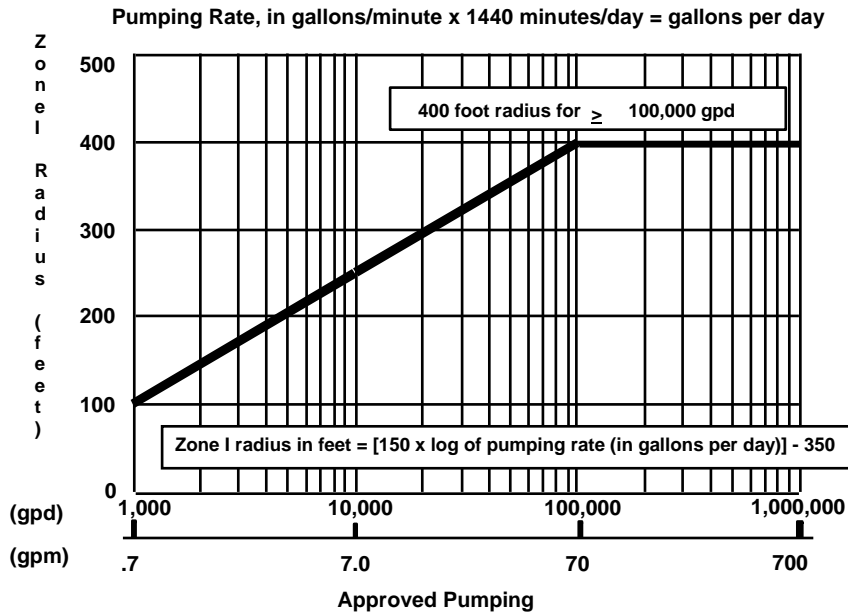

A minimum Zone I radius of 100 feet shall be applied to all groundwater sources with Approved Yields of 1,000 gallons per day or less.

IWPA Radius vs. Pumping Rate

