


Large Office¹ vs. Small Office



Heating End Use and TEDI

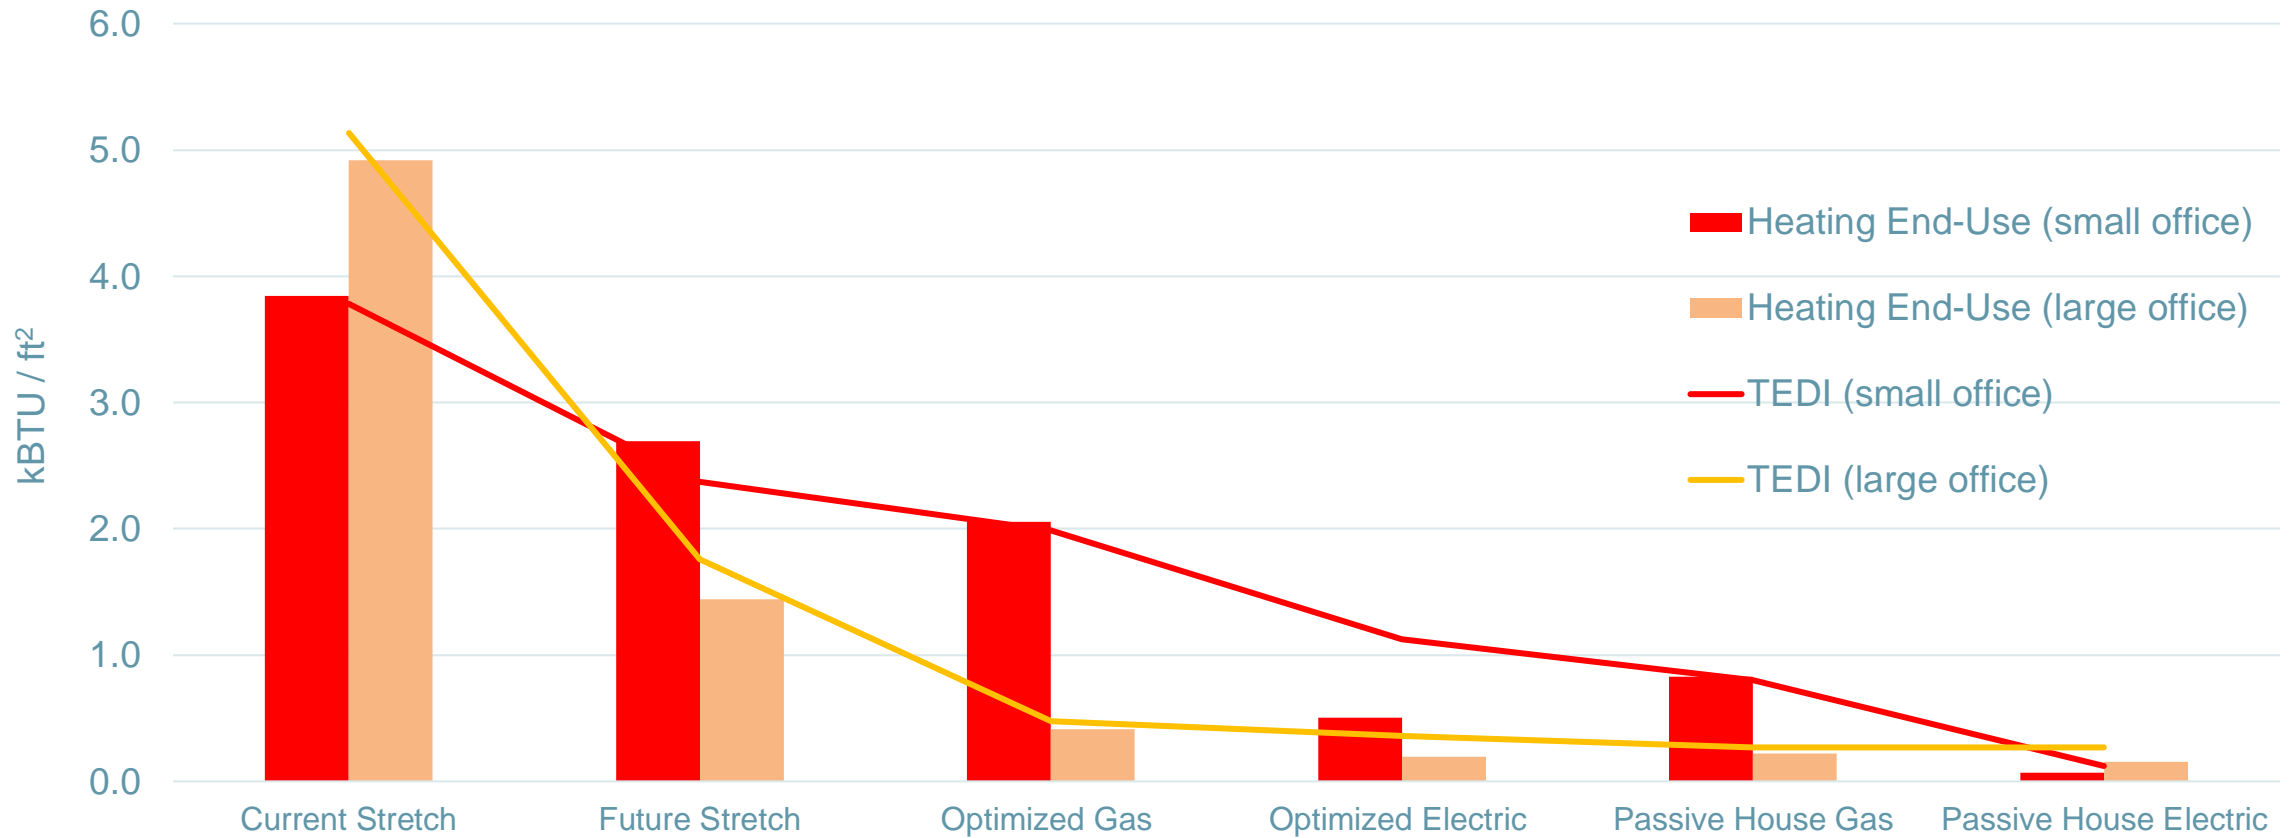


140% WWR Large Office

Large Office¹ vs. Small Office



Cooling End Use and TEDI

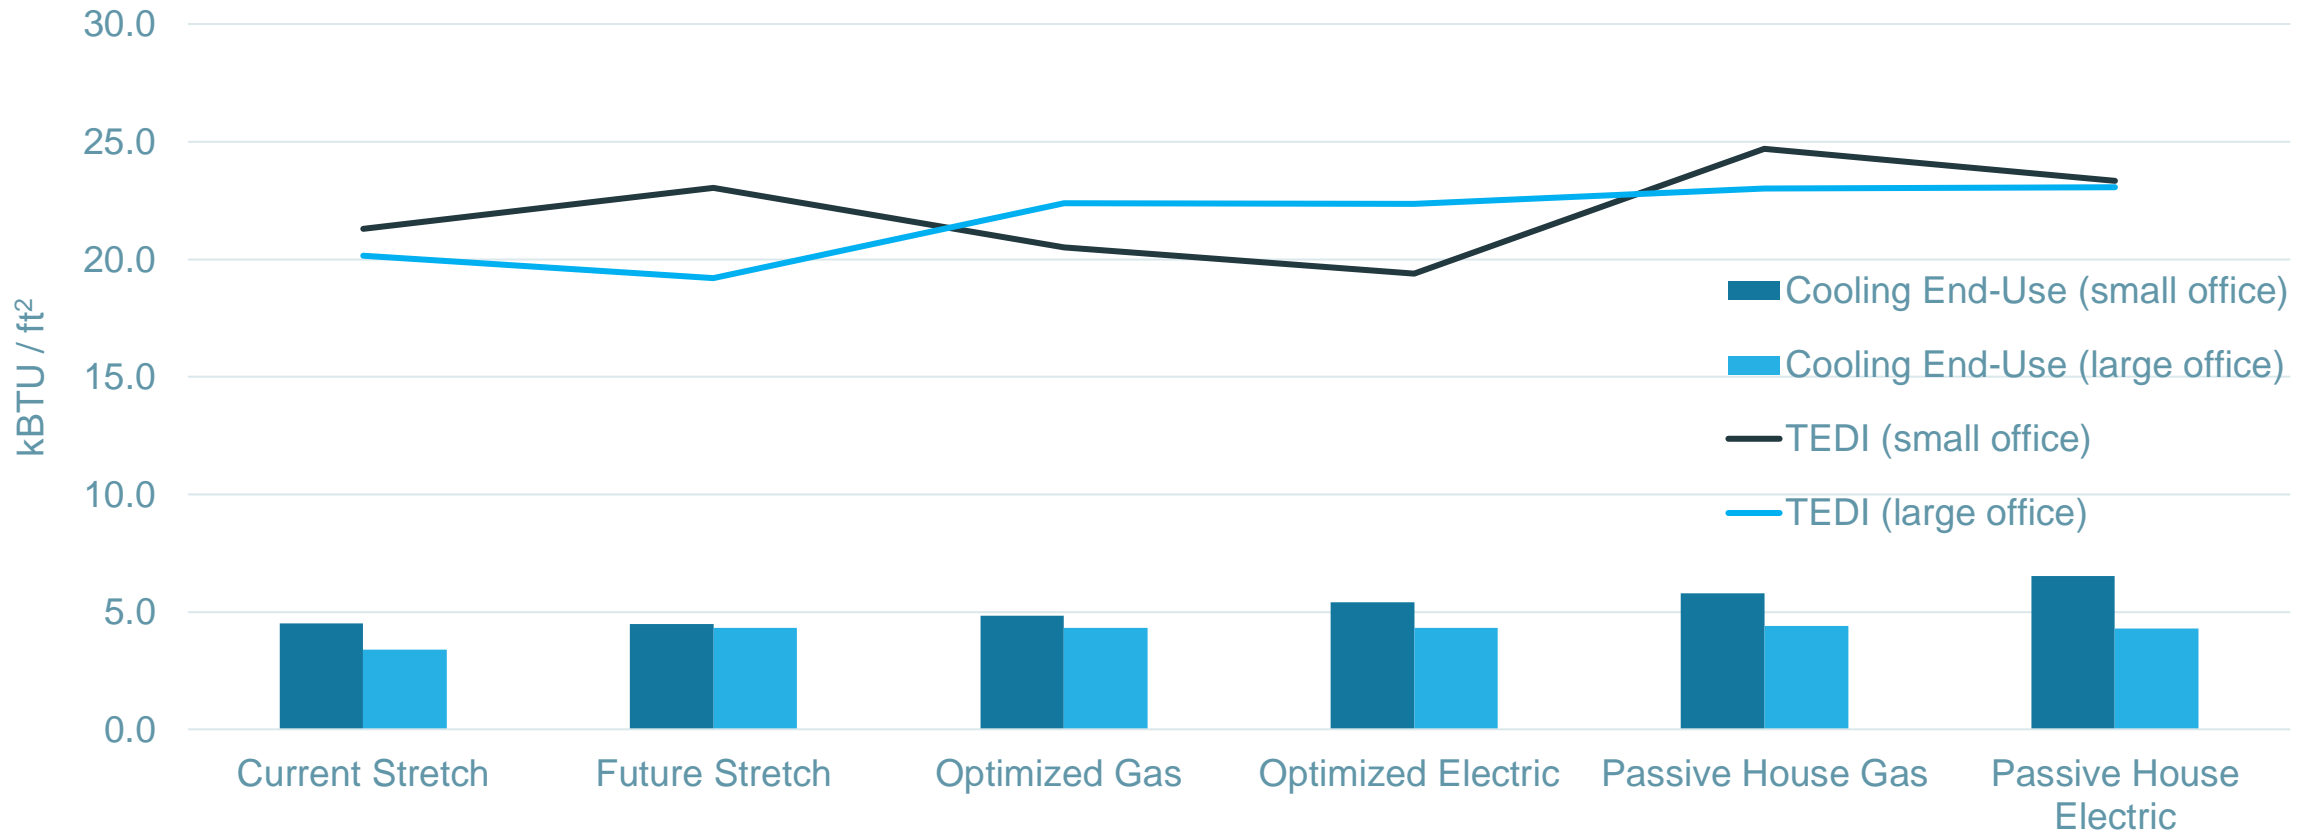

140% WWR Large Office