



Massachusetts Department of Environmental Protection
Source Water Assessment and Protection (SWAP) Report
for
Plymouth Water Division

What is SWAP?

The Source Water Assessment and Protection (SWAP) program, established under the federal Safe Drinking Water Act, requires every state to:

- inventory land uses within the recharge areas of all public water supply sources;
- assess the susceptibility of drinking water sources to contamination from these land uses; and
- publicize the results to provide support for improved protection.

Susceptibility and Water Quality

Susceptibility is a measure of a water supply's potential to become contaminated due to land uses and activities within its recharge area.

A source's susceptibility to contamination does *not* imply poor water quality.

Water suppliers protect drinking water by monitoring for more than 100 chemicals, disinfecting, filtering, or treating water supplies, and using source protection measures to ensure that safe water is delivered to the tap.

Actual water quality is best reflected by the results of regular water tests. To learn more about your water quality, refer to your water supplier's annual Consumer Confidence Reports.

Table 1: Public Water System Information

<i>PWS Name</i>	Plymouth Water Division
<i>PWS Address</i>	11 Lincoln Street
<i>City/Town</i>	Plymouth, Massachusetts
<i>PWS ID Number</i>	4239000
<i>Local Contact</i>	Davis S. Proctor
<i>Phone Number</i>	(508) 830-4155

Introduction

We are all concerned about the quality of the water we drink. Drinking water wells may be threatened by many potential contaminant sources, including storm runoff, road salting, and improper disposal of hazardous materials. Citizens and local officials can work together to better protect these drinking water sources.

Purpose of this report:

This report is a planning tool to support local and state efforts to improve water supply protection. By identifying land uses within water supply protection areas that may be potential sources of contamination, the assessment helps focus protection efforts on appropriate Best Management Practices (BMPs) and drinking water source protection measures.


Refer to Table 3 for Recommendations to address potential sources of contamination. Department of Environmental Protection (DEP) staff are available to provide information about funding and other resources that may be available to your community.

This report includes the following sections:

1. Description of the Water System
2. Land Uses within Protection Areas
3. Source Water Protection Conclusions and Recommendations
4. Appendices

What is a Protection Area?

A well's water supply protection area is the land around the well where protection activities should be focused. Each well has a Zone I protective radius and a Zone II protection area.

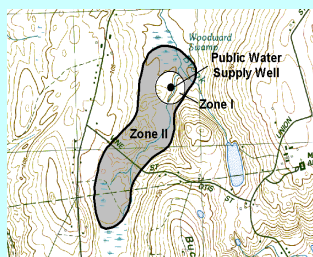

Section 1: Description of the Water System

<i>Zone II #:</i>	<i>Well Names</i>	<i>Source IDs</i>	<i>Susceptibility:</i>
401	Lout Pond GP Well	4239000-01G	High
397	Wannos Pond Well	4239000-02G	High
398	Ship Pond Well	4239000-03G	High
395	Federal Furnace GP Well	4239000-04G	Moderate
396	North Plymouth GP Well	4239000-05G	High
400	Bradford GP Well	4239000-06G	High
399	Ellisville GP Well	4239000-07G	High
25	Darby Pond Well	4239000-08G	High
197	South Pond Well #1	4239000-09G	High
197	South Pond Well #2	4239000-10G	High
413	Savery Pond Well	4239000-11G	Moderate

Glossary

Aquifer: An underground water-bearing layer of permeable material that will yield water in a usable quantity to a well.

Hydrogeologic Barrier: An underground layer of impermeable material (i.e. clay) that resists penetration by water.

Recharge Area: The surface area that contributes water to a well.

Zone I: The area closest to a well; a 100 to 400 foot radius proportional to the well's pumping rate. This area should be owned or controlled by the water supplier and limited to water supply activities.

Zone II: The primary recharge area for the aquifer. This area is defined by hydrogeologic studies that must be approved by DEP. Refer to the attached map to determine the land within your Zone II.

The Plymouth Water Division receives its water from eleven groundwater wells located in ten Zone II recharge areas; see above Table for a list of wells and corresponding Zone IIs. An assessment of the Lout Pond GP Well is included in this report, though it is not currently in use and is listed as inactive by DEP. Plymouth also has two surface water supplies, Great South Pond and Little South Pond, which are considered emergency sources, therefore, assessments of these sources are not included in this report. Each well has a Zone I of 400 feet. The wells are located in an aquifer with a high vulnerability to contamination due to the absence of hydrogeologic barriers (i.e. clay) that can prevent contaminant migration. Please refer to the attached map to view the boundaries of the Zone Is and Zone IIs.

All of Plymouth's wells are treated with sodium hydroxide for corrosion control and disinfected to prevent microbial growth. The Bradford GP Well also receives filtration for iron and manganese removal. For current information on monitoring results and treatment, please contact the Public Water System contact person listed above in Table 1 for a copy of the most recent Consumer Confidence Report. Drinking water monitoring reporting data are also available on the web at <http://www.epa.gov/safewater/ccr1.html>.

Section 2: Land Uses in the Protection Areas

The Zone IIs for Plymouth are dominated by forest with smaller areas of residential, agricultural, commercial, and light industrial land uses (refer to attached map for details). Land uses and activities that are potential sources of contamination are listed in Table 2, with further detail provided in the Table of Regulated Facilities and Table of Underground Storage Tanks in Appendix A.

Key Land Uses and Protection Issues include:

1. Inappropriate activities in Zone I
2. Residential land uses
3. Transportation corridors

4. Hazardous materials storage and use
5. Agricultural activities
6. Comprehensive wellhead protection planning

The overall ranking of susceptibility to contamination for the system is high, based on the presence of at least one high threat land use within the water supply protection areas, as seen in Table 2.

1. Inappropriate Activities in Zone Is – The Zone I for each of the wells is a 400 foot radius around the wellhead. Massachusetts drinking water regulations (310 CMR 22.00 Drinking Water) requires public water suppliers to own the Zone I, or control the Zone I through a conservation restriction. Nine of the twelve Zone Is comply with DEP requirements. Only water supply activities are allowed in the Zone I. However, many public water supplies were developed prior to the Department's regulations and contain non water supply activities such as homes and public roads. The following non water supply activities occur in the Zone Is of the system wells:

Wannos Pond Well 4239000-02G and Ship Pond Well 4239000-03G – There are homes with on-site septic systems within the Zone Is.

Darby Pond Well 4239000-08G – There are cranberry bogs in the Zone I.

Zone I Recommendations:

- ✓ To the extent possible, remove all non water supply activities from the Zone Is to comply with DEP's Zone I requirements.
- ✓ Use BMPs for the storage, use, and disposal of hazardous materials such as water supply chemicals and maintenance chemicals.
- ✓ Do not use or store pesticides, fertilizers or road salt within the Zone I.
- ✓ Keep any new non water supply activities out of the Zone I.

2. Residential Land Uses – Residential areas are common throughout all of the Zone IIs. None of the areas have public sewers, and so all use septic systems. If managed improperly, activities associated with residential areas can contribute to drinking water contamination. Common potential sources of contamination include:

- **Septic Systems** – Improper disposal of household hazardous chemicals to septic systems is a potential source of contamination to the

groundwater because septic systems lead to the ground. If septic systems fail or are not properly maintained they can be a potential source of microbial contamination.


- **Household Hazardous Materials** - Hazardous materials may include automotive wastes, paints, solvents, pesticides, fertilizers, and other substances. Improper use, storage, and disposal of chemical products used in homes are potential sources of contamination.
- **Heating Oil Storage** - If managed improperly, Underground and Aboveground Storage Tanks (UST and AST) can be potential sources of contamination due to leaks or spills of the fuel oil they store.

Benefits of Source Protection

Source Protection helps protect public health and is also good for fiscal fitness:

- Protects drinking water quality at the source
- Reduces monitoring costs through the DEP Waiver Program
- Treatment can be reduced or avoided entirely, saving treatment costs
- Prevents costly contamination clean-up
- Preventing contamination saves costs on water purchases, and expensive new source development

Contact your regional DEP office for more information on Source Protection and the Waiver Program.

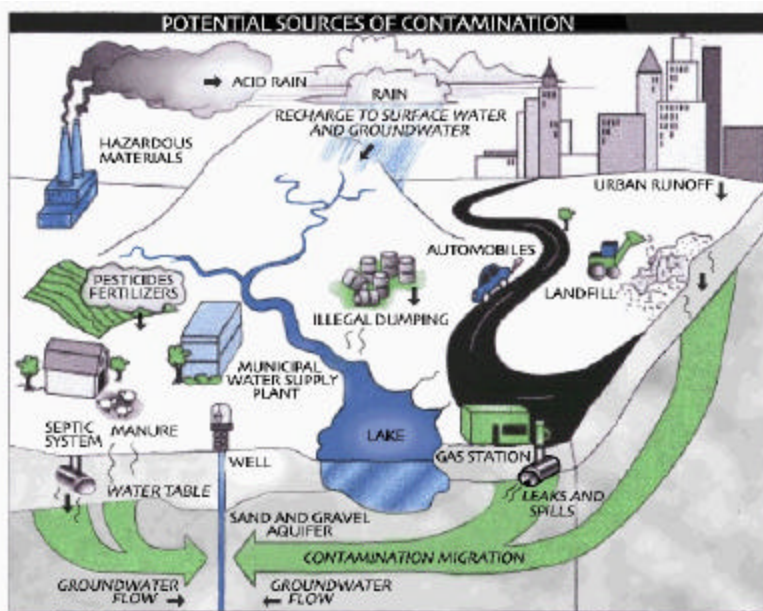

- **Stormwater** – Catch basins transport stormwater from roadways and adjacent properties to the ground. As flowing stormwater travels, it picks up debris and contaminants from streets and lawns. Common potential contaminants include lawn chemicals, pet waste, and contaminants from automotive leaks, maintenance, washing, or accidents.

Residential Land Use Recommendations:

- ✓ Educate residents on best management practices (BMPs) for protecting water supplies. Distribute the fact sheet “Residents Protect Drinking Water” available in Appendix C and on www.mass.gov/dep/brp/dws/protect.htm, which provides BMPs for common residential issues.
- ✓ Work with planners to control new residential developments in the water supply protection areas.
- ✓ Promote BMPs for stormwater management and pollution controls. Visit DEP’s web site for additional information and assistance at <http://www.state.ma.us/dep/brp/wm/nonpoint.htm>.

What are “BMPs?”

Best Management Practices (BMPs) are measures that are used to protect and improve surface water and groundwater quality. BMPs can be structural, such as oil & grease trap catch basins, nonstructural, such as hazardous waste collection days or managerial, such as employee training on proper disposal procedures.

3. Transportation Corridors - Route 3 runs through the Zone II for the Savery Pond Well. Local roads are common throughout all the Zone IIs. Roadway construction, maintenance, and typical highway use can all be potential sources of contamination. Accidents can lead to spills of gasoline and other potentially dangerous transported chemicals. Roadways are frequent sites for illegal dumping of hazardous or other potentially harmful wastes. De-icing salt, automotive chemicals and other debris on roads are picked up by stormwater and wash in to catchbasins.

Transportation Corridor Recommendations:

- ✓ Wherever possible, ensure that drains discharge stormwater outside of the Zone I.
- ✓ Identify stormwater drains and the drainage system along transportation corridors. If maps aren’t yet available, work with town officials to investigate mapping options such as the upcoming Phase II Stormwater Rule requiring some communities to complete stormwater mapping.
- ✓ Work with local emergency response teams to ensure that any spills within

For More Information

Contact Isabel Collins in DEP’s Lakeville Office at (508) 946-2726 for more information and assistance on improving current protection measures.

Copies of this report have been provided to the public water supplier, board of health, and the town.

the Zone II can be effectively contained. Review storm drainage maps with emergency response teams.

- ✓ Work with the Town and State to best manage stormwater in the Zone II. Best management practices include street sweeping, vegetative swales, and regular catch basin inspection, cleaning and maintenance.

4. Hazardous Materials Storage and Use

Small areas of the Zone IIs are used for commercial or industrial land uses. Activities associated with commercial and industrial land use are often the greatest concern when evaluating water supply protection. Many small businesses and industries use hazardous materials, produce hazardous waste products, and/or store large quantities of hazardous materials in UST/AST. If hazardous materials are improperly stored, used, or disposed, they become potential sources of contamination. Hazardous materials should never be disposed of to a septic system or floor drain leading directly to the ground.

(Continued on page 7)

Source Protection Decreases Risk

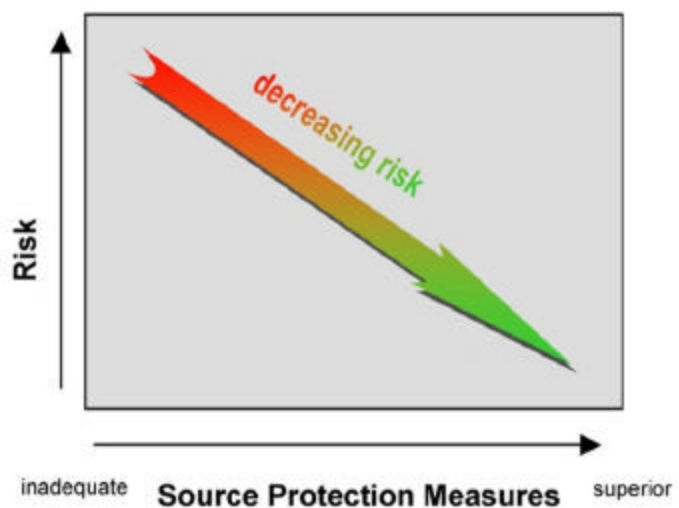


Figure 2: Risk of contamination decreases as source protection increases. This is true for public water systems of any susceptibility ranking, whether High, Moderate, or Low.

Potential Source of Contamination vs. Actual Contamination

The activities listed in Table 2 are those that typically use, produce, or store contaminants of concern, which, if managed improperly, are potential sources of contamination (PSC).

It is important to understand that a release may never occur from the potential source of contamination provided facilities are using best management practices (BMPs). If BMPs are in place, the actual risk may be lower than the threat ranking identified in Table 2. Many potential sources of contamination are regulated at the federal, state and/or local levels, to further reduce the risk.

Table 2: Land Use in the Protection Areas (Zones I and II)

For more information, refer to Appendix A: Regulated Facilities within the Water Supply Protection Area

Activities	Quantity	Threat*	Zone II#	Potential Source of Contamination
Agricultural				
Pesticide Storage or Use	9	H	#25, #197, #397, #398, #399, #400 & #401	Pesticides: leaks, spills, improper handling, or over-application (Cranberry Bogs, Agway and Home Depot)
Fertilizer Storage or Use	9	M	#25, #197, #397, #398, #399, #400 & #401	Fertilizers: leaks, spills, improper handling, or over-application (Cranberry Bogs, Agway and Home Depot)
Commercial				
Bus Washes	1	L	#400	Vehicle wash water, soaps, oils, greases, metals, and salts: improper management
Service Stations/ Auto Repair Shops	1	H	#400	Automotive fluids and solvents: spills, leaks, or improper handling
Medical Facilities	1	M	#396	Biological, chemical, and radioactive wastes: spills, leaks, or improper handling or storage (Two dental offices)
Printer And Blueprint Shops	1	M	#396	Printing inks and chemicals: spills, leaks, or improper handling or storage
Sand And Gravel Mining/Washing	1	M	#396 & #400	Heavy equipment, fuel storage, clandestine dumping: spills or leaks
Industrial				
Asphalt, Coal Tar, And Concrete Plants	1	M	#396	Hazardous chemicals and wastes: spills, leaks, or improper handling or storage
Industry/Industrial Parks	2	H	#25 & #396	Industrial chemicals and metals: spills, leaks, or improper handling or storage

Table 2 Continued: Land Use in the Protection Areas (Zones I and II)

For more information, refer to Appendix A: Regulated Facilities within the Water Supply Protection Area

Activities	Quantity	Threat*	Zone II#	Potential Source of Contamination
Residential				
Fuel Oil Storage (at residences)	Numerous	M	All	Fuel oil: spills, leaks, or improper handling
Lawn Care / Gardening	Numerous	M	All	Pesticides: over-application or improper storage and disposal
Septic Systems / Cesspools	Numerous	M	All	Hazardous chemicals: microbial contaminants, and improper disposal
Miscellaneous				
Aquatic Wildlife	Numerous	L	All	Microbial contaminants
Fishing/Boating	Numerous	L	All	Fuel and other chemical spills, microbial contaminants
Schools, Colleges, and Universities	1	M	#400	Fuel oil, laboratory, art, photographic, machine shop, and other chemicals: spills, leaks, or improper handling or storage
Stormwater Drains/ Retention Basins	Numerous	L	All	Debris, pet waste, and chemicals in stormwater from roads, parking lots, and lawns
Transmission Line Rights-of-Way - Type: Electric	2	L	#25 & #400	Corridor maintenance pesticides: over-application or improper handling; construction

Table 2 Notes:

1. When specific potential contaminants are not known, typical potential contaminants or activities for that type of land use are listed. Facilities within the watershed may not contain all of these potential contaminant sources, may contain other potential contaminant sources, or may use Best Management Practices to prevent contaminants from reaching drinking water supplies.
2. For more information on regulated facilities, refer to Appendix A: Regulated Facilities within the Water Supply Protection Area information about these potential sources of contamination.
3. For information about Oil or Hazardous Materials Sites in your protection areas, refer to Appendix B: Tier Classified Oil and/or Hazardous Material Sites.

* **THREAT RANKING** - The rankings (high, moderate or low) represent the relative threat of each land use compared to other PSCs. The ranking of a particular PSC is based on a number of factors, including: the type and quantity of chemicals typically used or generated by the PSC; the characteristics of the contaminants (such as toxicity, environmental fate and transport); and the behavior and mobility of the pollutants in soils and groundwater.

(Continued from page 4)

Hazardous Materials Storage and Use Recommendations:

- ✓ Educate local businesses on best management practices for protecting water supplies. Distribute the fact sheet “Businesses Protect Drinking Water” available in Appendix C and on www.mass.gov/dep/brp/dws/protect.htm, which provides BMP’s for common business issues.
- ✓ Work with local businesses to register those facilities that are unregistered generators of hazardous waste or waste oil. Partnerships between businesses, water suppliers, and communities enhance successful public drinking water protection practices.
- ✓ Educate local businesses on Massachusetts floordrain requirements. See brochure “Industrial Floor Drains” for more information.

5. Agricultural Activities – There are several farms within the Zone II. Pesticides and fertilizers have the potential to contaminate a drinking water source if improperly stored, applied, or disposed. If not contained or applied properly, animal waste from barnyards, manure pits and field application are potential sources of contamination to ground and surface water.

Agricultural Activities Recommendation:

- ✓ Work with farmers in your protection areas to make them aware of your water supply and to encourage the use of a US Natural Resources Conservation Service farm plan to protect water supplies.
- ✓ Ensure that farmers within the Zone II maintain a pesticide license or certification with the Massachusetts Department of Food and Agriculture including all applicable training and recertification courses and follow applicable Best Management Practices as published by the University of Massachusetts Cranberry experiment station.
- ✓ Work with farmers to investigate grants and loans designed to protect surface and groundwater. See <http://www.nrcs.usda.gov/programs/farmbill/2002/pdf/EQIPFct.pdf> for more information on the USDA Environmental Quality Incentives Program (EQIP). Information on the MA Department of Food Agriculture’s Agricultural Environmental Enhancement Program (AEEP) is available on the web at <http://www.state.ma.us/dfa/programs/aEEP/>.

Top 5 Reasons to Develop a Local Wellhead Protection Plan

- ❶ Reduces Risk to Human Health
- ❷ Cost Effective! Reduces or Eliminates Costs Associated With:
 - ♦ Increased groundwater monitoring and treatment
 - ♦ Water supply clean up and remediation
 - ♦ Replacing a water supply
 - ♦ Purchasing water
- ❸ Supports municipal bylaws, making them less likely to be challenged
- ❹ Ensures clean drinking water supplies for future generations
- ❺ Enhances real estate values – clean drinking water is a local amenity. A community known for its great drinking water in a place people want to live and businesses want to locate.



6. Protection Planning – Currently, Plymouth has water supply protection controls that meet DEP’s Wellhead Protection regulations 310 CMR 22.21(2). A Wellhead Protection Plan coordinates community efforts, identifies protection strategies, establishes a timeframe for implementation, and provides a forum for public participation. There are resources available to help communities develop a plan for protecting drinking water supply wells.

Protection Planning Recommendations:

- ✓ Establish a protection team, and use them to implement the goals of your Wellhead Protection Plan.
- ✓ Coordinate efforts with local officials to compare local wellhead protection controls with current MA Wellhead Protection Regulations 310 CMR 22.21(2). If they no longer meet the current regulations, adopt controls that meet 310 CMR 22.21(2). For more information on DEP land use controls see <http://mass.gov/dep/brp/dws/protect.htm>.
- ✓ If local controls do not regulate floordrains, be sure to include floordrain controls that meet 310 CMR 22.21(2).
- ✓ Work with town boards to review and provide recommendations on proposed development within your water supply protection areas. To obtain information on build-out analyses for the town, see the Executive Office of Environmental Affairs’ community preservation web site, <http://commpres.env.state.ma.us/>.

Table 3: Current Protection and Recommendations

Protection Measures	Status	Recommendations
Zone I		
Does the Public Water Supplier (PWS) own or control the entire Zone I?	YES/NO	When feasible, gain control of Zone Is through ownership or conservation restrictions. Educate residents within Zone Is on BMPs for septic, lawn care and hazardous material use and storage.
Is the Zone I posted with “Public Drinking Water Supply” Signs?	YES	Additional economical signs are available from the Northeast Rural Water Association (802) 660-4988.
Is Zone I regularly inspected?	YES	Continue daily inspections of drinking water protection areas.
Are water supply-related activities the only activities within the Zone I?	YES	Continue monitoring non-water supply activities in Zone Is.
Municipal Controls (Zoning Bylaws, Health Regulations, and General Bylaws)		
Does the municipality have Wellhead Protection Controls that meet 310 CMR 22.21(2)?	YES	The Town “Aquifer Protection District” bylaw meets DEP’s requirements for wellhead protection. Refer to www.state.ma.us/dep/brp/dws/ for model bylaws and health regulations, and current regulations.
Do neighboring communities protect the Zone II areas extending into their communities?	YES/NO	Work with Carver to include Zone IIs in their wellhead protection controls. Continue reciprocal protection efforts with Kingston.
Planning		
Does the PWS have a Wellhead Protection Plan?	YES	Use Wellhead Protection Committee to implement goals of Wellhead Protection Plan.
Does the PWS have a formal “Emergency Response Plan” to deal with spills or other emergencies?	YES	Augment plan by developing a joint emergency response plan with fire department, Board of Health, DPW, and local and state emergency officials. Coordinate emergency response drills with local teams.
Does the municipality have a wellhead protection committee?	NO	Establish committee; include representatives from citizens’ groups, neighboring communities, and the business community.
Does the Board of Health conduct inspections of commercial and industrial activities?	YES	For more guidance see “Hazardous Materials Management: A Community's Guide” at www.state.ma.us/dep/brp/dws/files/hazmat.doc
Does the PWS provide wellhead protection education?	YES	Aim additional efforts at commercial, industrial and municipal uses within the Zone II.

Other land uses and activities within the Zone II include auto repair shops, industrial parks, and sand and gravel mining. Refer to Table 2 and Appendix A for more information about these land uses.

Identifying potential sources of contamination is an important initial step in protecting your drinking water sources. Further local investigation will provide more in-depth information and may identify new land uses and activities that are potential sources of contamination. Once potential sources of contamination are identified, specific recommendations like those below should be used to better protect your water supply.

Section 3: Source Water Protection Conclusions and Recommendations

Current Land Uses and Source Protection:

As with many water supply protection areas, the system Zone IIs contain potential sources of contamination. However, source protection measures reduce the risk of actual contamination, as illustrated in Figure 2.

The water supplier is commended for taking an active role in promoting source protection measures in the Water Supply Protection Areas through coordination with watershed committees, coordination with the Board of Health's inspection program and providing education to schools and residents.

Source Protection Recommendations:

To better protect the sources for the future:

- ✓ Continue regular Zone inspections, and when feasible, remove any non-water supply activities.
- ✓ Continue to educate residents on ways they can help you to protect drinking water sources.
- ✓ Work with emergency response teams to ensure that they are aware of the stormwater drainage in your Zone II and to cooperate on responding to spills or accidents.
- ✓ Partner with local businesses to ensure the proper storage, handling, and disposal of hazardous materials.
- ✓ Work with Cranberry growers in your protection areas to make them aware of your water supply and to encourage the use of a NRCS farm plan to protect water supplies.
- ✓ Develop and implement a Wellhead Protection Plan.

Conclusions:

These recommendations are only part of your ongoing local drinking water source protection. Additional source protection recommendations are listed in Table 3, the Key Issues above and Appendix C.

DEP staff, informational documents, and resources are available to help you build on this SWAP report as you continue to improve drinking water protection in your community. Grants and loans are available through the Drinking Water State Revolving Loan Fund, the Clean Water State Revolving Fund, and other sources. For more information on grants and loans, visit the Bureau of Resource Protection's Municipal Services web site at: <http://mass.gov/dep/brp/mf/mfpubs.htm>.

What is a Zone III?

A Zone III (the secondary recharge area) is the land beyond the Zone II from which surface and ground water drain to the Zone II and is often coincident with a watershed boundary.

The Zone III is defined as a secondary recharge area for one or both of the following reasons:

1. The low permeability of underground water bearing materials in this area significantly reduces the rate of groundwater and potential contaminant flow into the Zone II.
2. The groundwater in this area discharges to a surface water feature such as a river, rather than discharging directly into the aquifer.

The land uses within the Zone III are assessed only for sources that are shown to be groundwater under the direct influence of surface water.

Additional Documents:

To help with source protection efforts, more information is available by request or online at mass.gov/dep/brp/dws including:

1. Water Supply Protection Guidance Materials such as model regulations, Best Management Practice information, and general water supply protection information.
2. MA DEP SWAP Strategy
3. Land Use Pollution Potential Matrix
4. Draft Land/Associated Contaminants Matrix

The assessment and protection recommendations in this SWAP report are provided as a tool to encourage community discussion, support ongoing source protection efforts, and help set local drinking water protection priorities. Citizens and community officials should use this SWAP report to spur discussion of local drinking water protection measures. The water supplier should supplement this SWAP report with local information on potential sources of contamination and land uses. Local information should be maintained and updated periodically to reflect land use changes in the Zone II. Use this information to set priorities, target inspections, focus education efforts, and to develop a long-term drinking water source protection plan.

Section 4: Appendices

- A. Regulated Facilities within the Water Supply Protection Area
- B. Table of Tier Classified Oil and/or Hazardous Material Sites within the Water Supply Protection Areas
- C. Additional Documents on Source Protection

APPENDIX A: REGULATED FACILITIES WITHIN THE WATER SUPPLY PROTECTION AREA

DEP Permitted Facilities

DEP Facility Number	Facility Name	Street Address	Town	Permitted Activity	Activity Class
772	ALGONQUIN HEIGHTS ASSOCIATION	ALGONQUIN TER	PLYMOUTH	Ground Water Facility (BRP)	Groundwater Discharge
29546	ACCURATE FABRICATORS INC	INDUSTRIAL PARK RD	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Hazardous Waste
35490	AGWAY PLYMOUTH	90 LONG POND RD	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Hazardous Waste
115377	JETCO MOLDING INC	51 ARMSTRONG RD	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Waste Oil or PCBs
115414	ROGERS PRINT INC	41 CHRISTA MCAULIFFE BLVD	PLYMOUTH	Generator of Hazardous Waste	Small Quantity Generator
115516	MEMORIAL PRESS GROUP	9 LONG POND RD	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Hazardous Waste
131354	TECH ETCH INC	45 ALDRIN RD	PLYMOUTH	Toxics Use Reduction Filer	Large Quantity Toxics User
131354	TECH ETCH INC	45 ALDRIN RD	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Waste Oil or PCBs
131354	TECH ETCH INC	45 ALDRIN RD	PLYMOUTH	Plant	Air Quality Permit
131354	TECH ETCH	45 ALDRIN RD	PLYMOUTH	Sewer Connection or Groundwater Discharge	Industrial Waste Water to Sewer
133473	PIXLEY RICHARDS INC	9 COLLINS AVE	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Hazardous Waste
133478	AAFCO TRANSMISSIONS	115 SANDWICH ST	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Hazardous Waste
261229	ELECTROPOLISH SYSTEMS INC	24 ALDRIN RD	PLYMOUTH	Sewer Connection or Groundwater Discharge	Air Quality Permit
261229	ELECTROPOLISH SYSTEMS	24 ALDRIN RD	PLYMOUTH	Generator of Hazardous Waste	Large Quantity Generator of Hazardous Waste

APPENDIX A: REGULATED FACILITIES WITHIN THE WATER SUPPLY PROTECTION AREA

DEP Facility Number	Facility Name	Street Address	Town	Permitted Activity	Activity Class
261229	ELECTROPOLISH SYSTEMS	24 ALDRIN RD	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Waste Oil or PCBs
261229	ELECTROPOLISH SYSTEMS INC	24 ALDRIN RD	PLYMOUTH	Toxics Use Reduction Filer	Air Quality Permit
261244	CRANBERRY GRAPHICS	19 RICHARDS RD	PLYMOUTH	Plant	Air Quality Permit
261244	CRANBERRY GRAPHICS INC	19 RICHARDS RD	PLYMOUTH	Generator of Hazardous Waste	Small Quantity Generator
286340	KING COLLISION CENTER OF PLYMOUTH	48 HALMAN RD	PLYMOUTH	Industrial Wastewater Holding Tank Approval	Industrial Waste Water Holding Tank
286340	KING COLLISION CENTER OF PLYMOUTH	48 HOLMAN RD	PLYMOUTH	Generator of Hazardous Waste	Small Quantity Generator
288502	MA ARMSTRONG SKATING RINK	LONG POND RD	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Waste Oil or PCBs
321282	AMERICANNA CO	29 ALDRIN RD	PLYMOUTH	Plant	Air Quality Permit
321282	AMERICANNA CO	29 ALDRIN RD	PLYMOUTH	Generator of Hazardous Waste	Very Small Quantity Generator of Waste Oil or PCBs
362080	GAMBRO HEALTHCARE	45 RESNICK ROAD	PLYMOUTH	Ground Water Facility (BRP)	Groundwater Discharge

APPENDIX A: REGULATED FACILITIES WITHIN THE WATER SUPPLY PROTECTION AREA

Underground Storage Tanks

Facility Name	Address	Town	Tank Material	Tank Type	Tank Leak Detection	Capacity (gal)	Contents
No Department Of Fire Services Registered USTs Were Identified during the Assessment.							

For more information on underground storage tanks, visit the Massachusetts Department of Fire Services web site: <http://www.state.ma.us/dfs/ust/ustHome.htm>

Note: This appendix includes only those facilities within the water supply protection area(s) that meet state reporting requirements and report to the appropriate agencies. Additional facilities may be located within the water supply protection area(s) that should be considered in local drinking water source protection planning.

APPENDIX B – Table of Tier Classified Oil and/or Hazardous Material Sites within the Water Supply Protection Areas

DEP's datalayer depicting oil and/or hazardous material (OHM) sites is a statewide point data set that contains the approximate location of known sources of contamination that have been both reported and classified under Chapter 21E of the Massachusetts General Laws. Location types presented in the layer include the approximate center of the site, the center of the building on the property where the release occurred, the source of contamination, or the location of an on-site monitoring well. Although this assessment identifies OHM sites near the source of your drinking water, the risks to the source posed by each site may be different. The kind of contaminant and the local geology may have an effect on whether the site poses an actual or potential threat to the source.

The DEP's Chapter 21E program relies on licensed site professionals (LSPs) to oversee cleanups at most sites, while the DEP's Bureau of Waste Site Cleanup (BWSC) program retains oversight at the most serious sites. This privatized program obliges potentially responsible parties and LSPs to comply with DEP regulations (the Massachusetts Contingency Plan – MCP), which require that sites within drinking water source protection areas be cleaned up to drinking water standards.

For more information about the state's OHM site cleanup process to which these sites are subject and how this complements the drinking water protection program, please visit the BWSC web page at <http://www.state.ma.us/dep/bwsc>. You may obtain site -specific information two ways: by using the BWSC Searchable Sites database at <http://www.state.ma.us/dep/bwsc/sitelist.htm>, or you may visit the DEP regional office and review the site file. These files contain more detailed information, including cleanup status, site history, contamination levels, maps, correspondence and investigation reports, however you must call the regional office in order to schedule an appointment to view the file.

The table below contains the list of Tier Classified oil and/or Hazardous Material Release Sites that are located within your drinking water source protection area.

Table 1: Bureau of Waste Site Cleanup Tier Classified Oil and/or Hazardous Material Release Sites (Chapter 21E Sites) - Listed by Release Tracking Number (RTN)

RTN	Release Site Address	Town	Contaminant Type
None Identified at this time.			

For more location information, please see the attached map. The map lists the release sites by RTN.

* Site recently classified, not reflected in current GIS map.