



# DG Run-On and High Voltage

Example: FG&E 8/21/2020


# Circuit 35W36 w/ PCC recloser R02385 at DG 4 MW, inverter-based, PV-driven




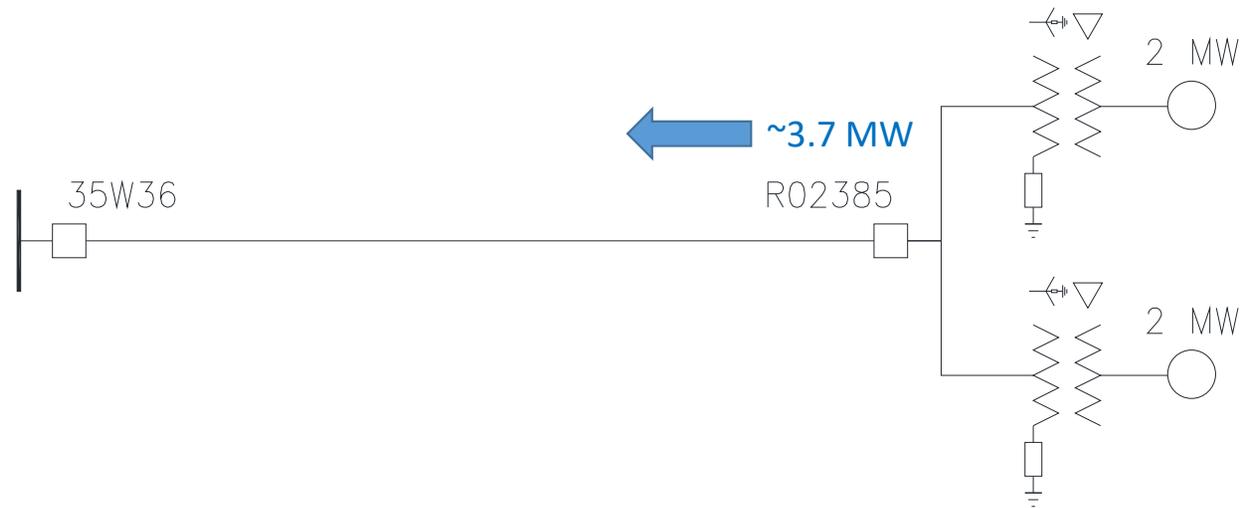


# Circuit 35W36 w/ PCC recloser R02385 at DG 4 MW, inverter-based, PV-driven

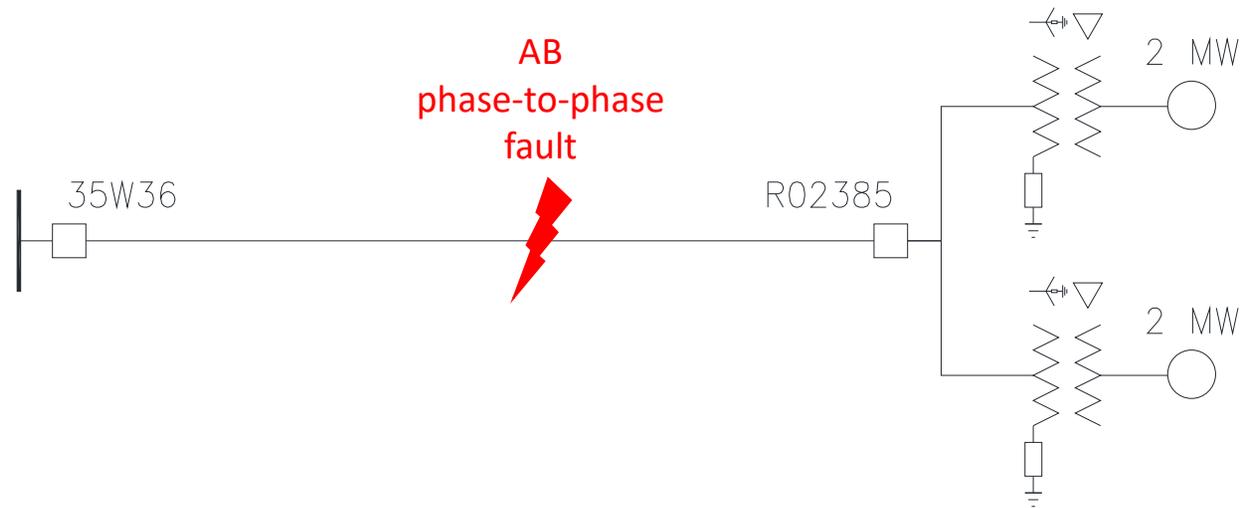


# 35W36 – fault, trip response & clearing

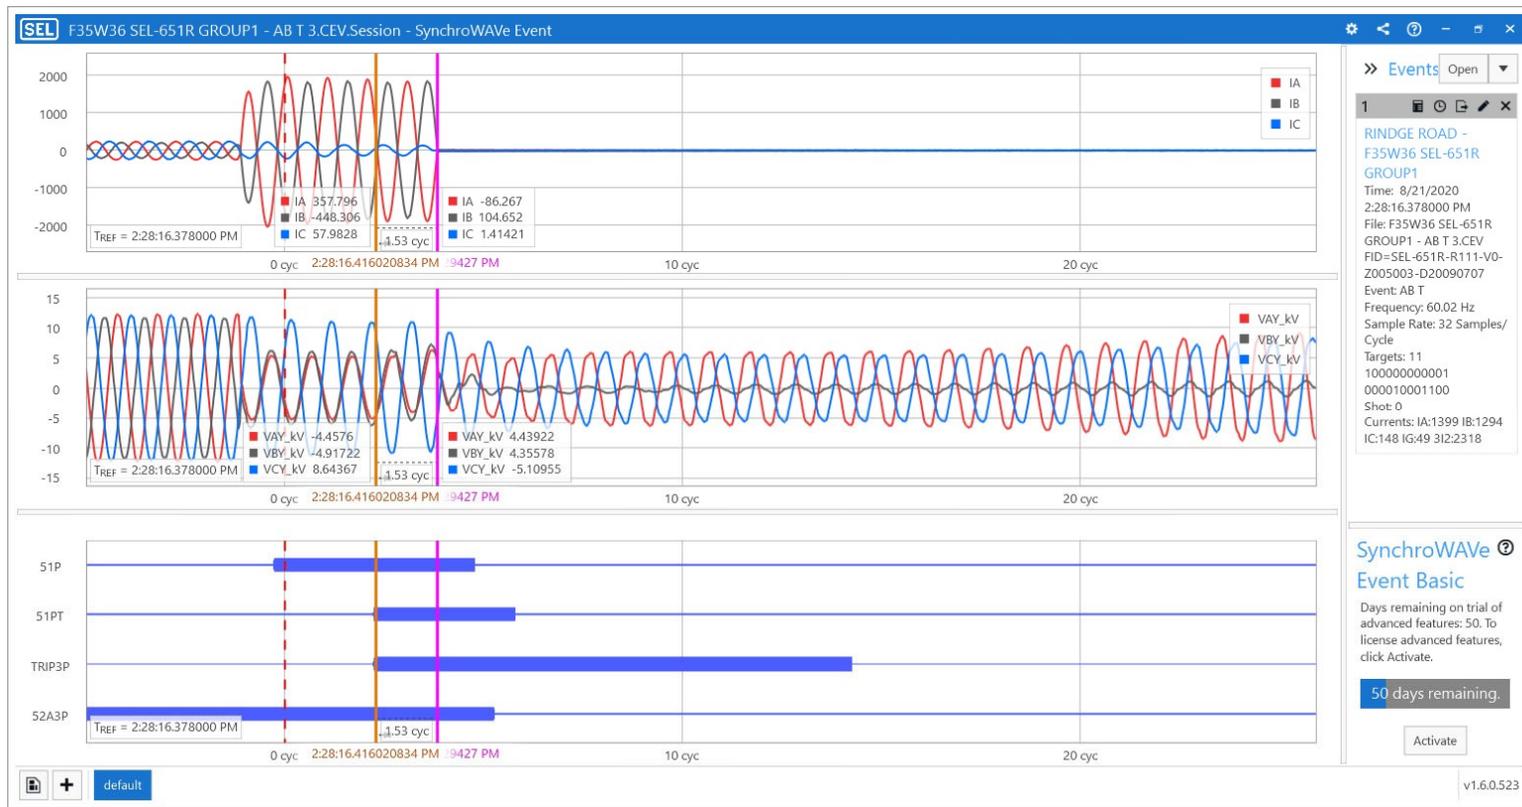


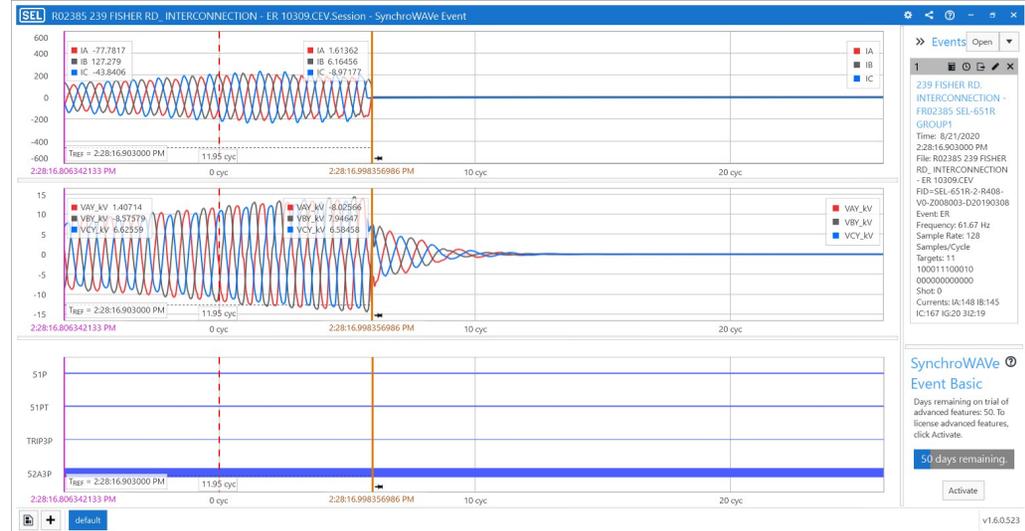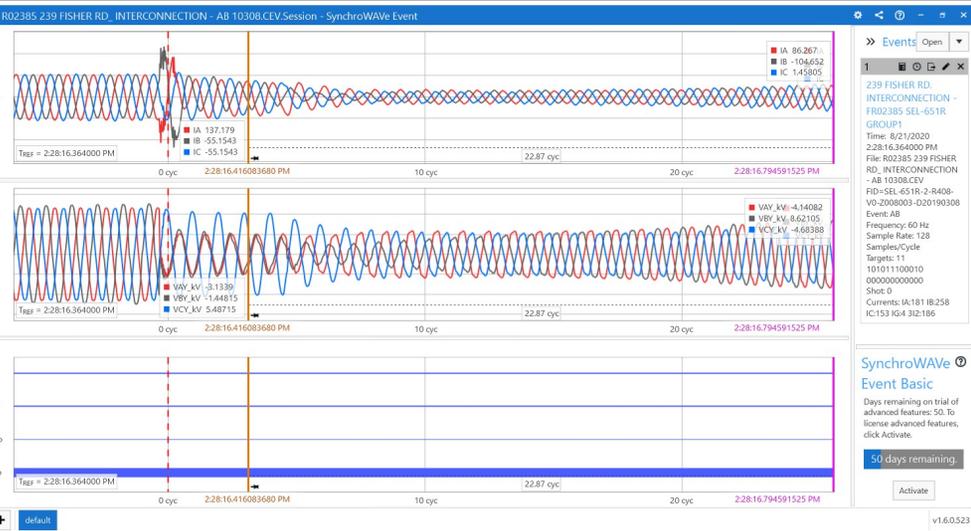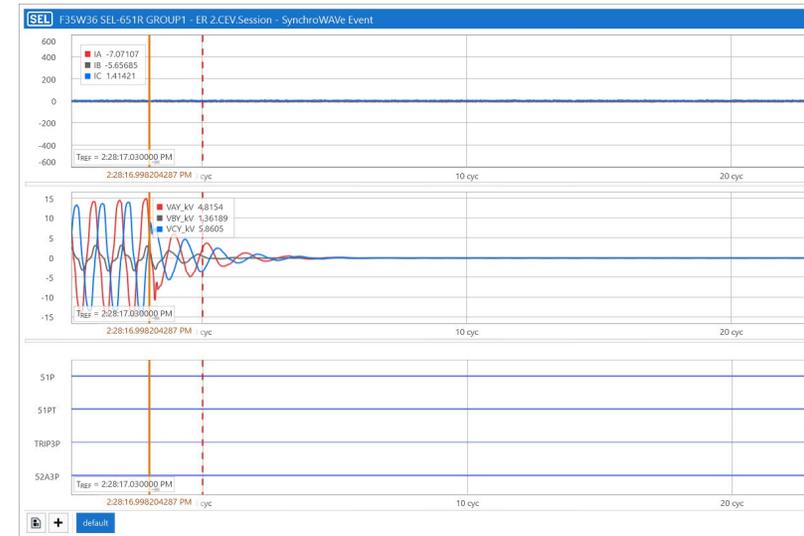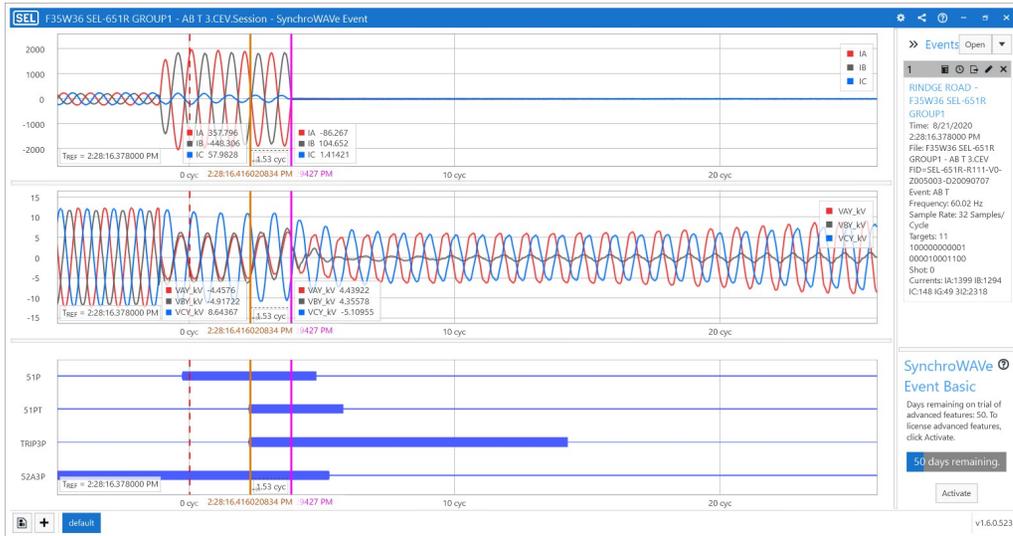


# R02385 w/ RMS approximations

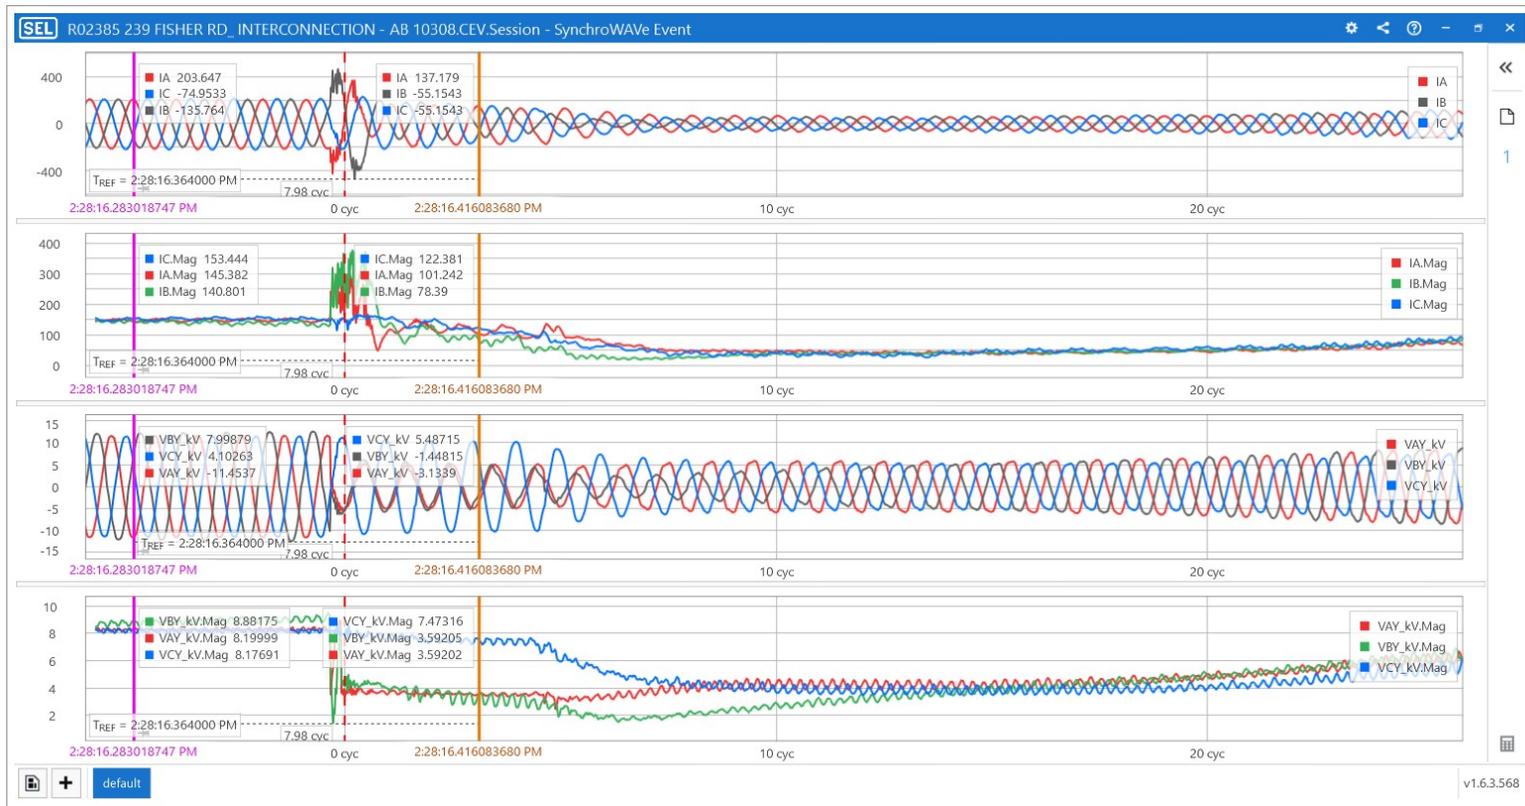

# R02385 – pre-fault

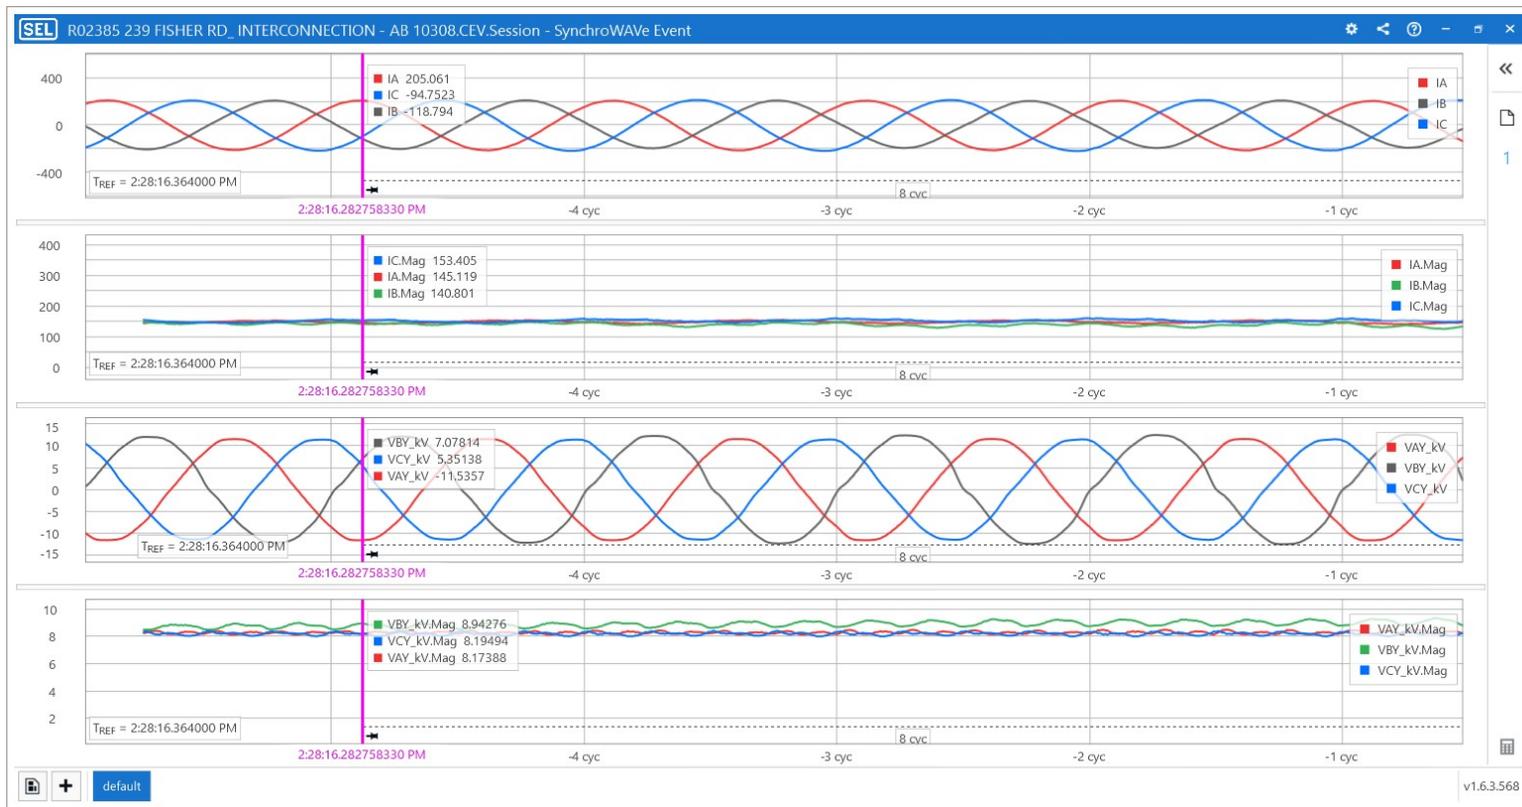

# R02385 – shortly after 35W36 clearing

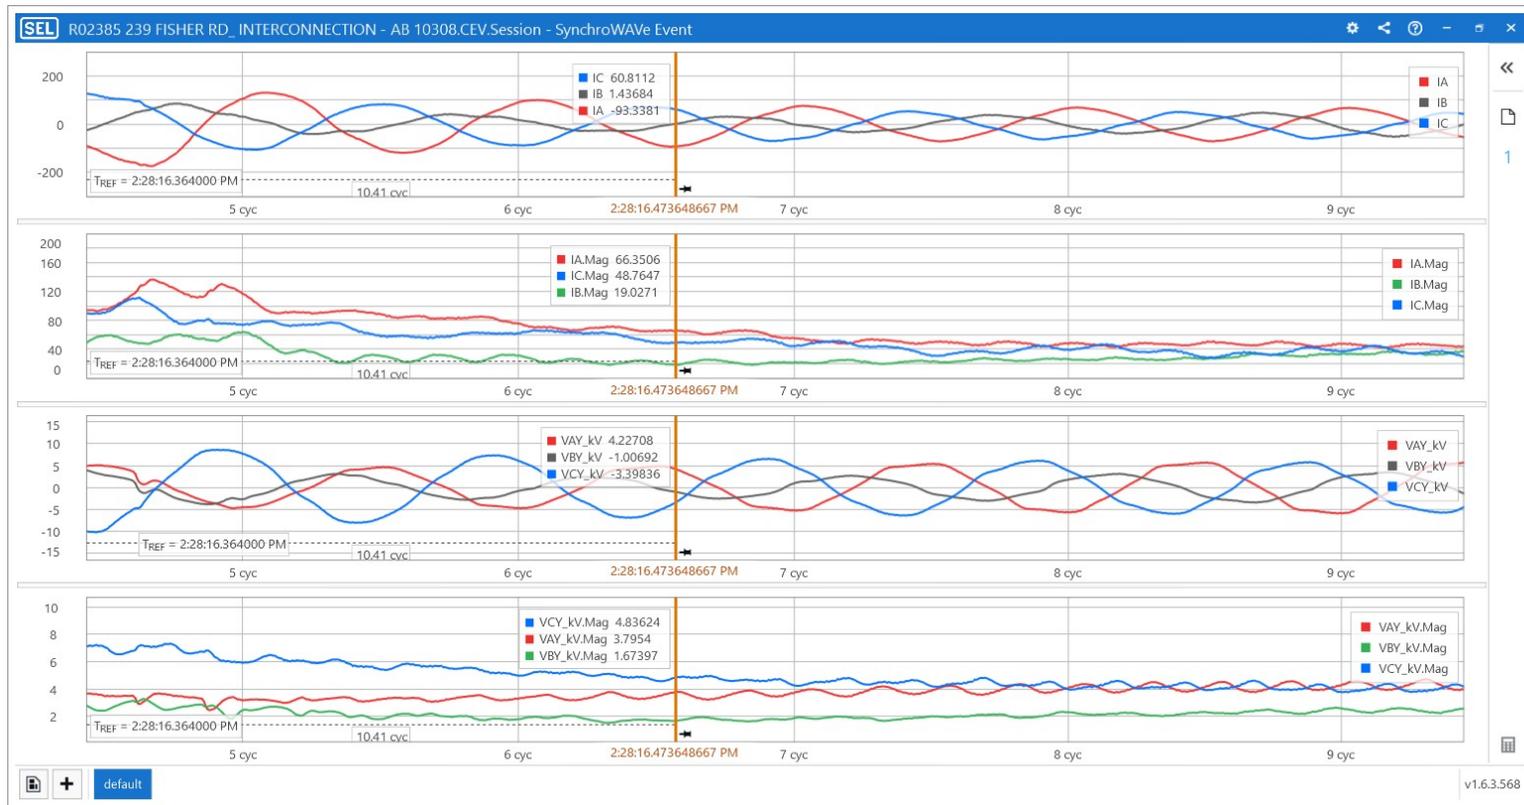

# R02385 – at shutdown

