


## TRENCH SECTION

N.T.S

(FOR TEMPORARY PAVING SEE NOTE 1)

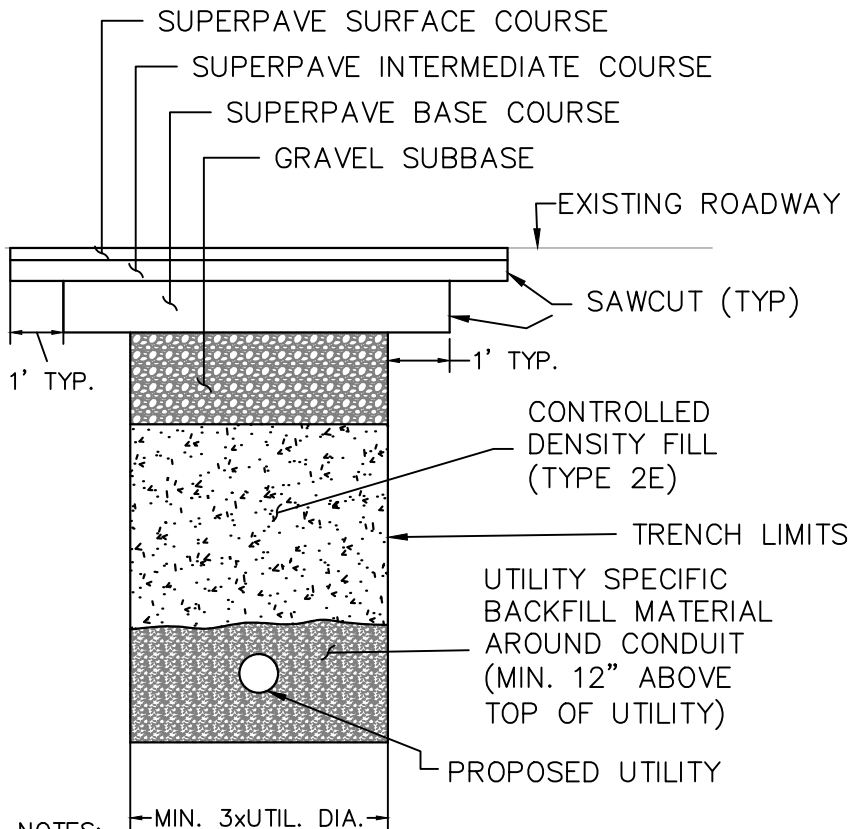

## PAVEMENT NOTES\*

PAVEMENT MIX DEPTH SHALL MATCH OR EXCEED THE EXISTING DEPTH OF HMA.

- 1.75" SUPERPAVE SURFACE COURSE 12.5 (SSC-12.5)
- 2.25" SUPERPAVE INTERMEDIATE COURSE 19.0 (SIC-19.0)
- 3.5" SUPERPAVE BASE COURSE 37.5 (SBC - 37.5)
- MINIMUM 12" GRAVEL SUB-BASE: (MAXIMUM 3" AGGREGATE SIZE)

\*TRENCHES ON FREEWAYS SHALL REQUIRE A PAVEMENT DESIGN TO BE SUBMITTED FOR APPROVAL

ALL HOT MIX ASPHALT SHALL BE PRODUCED WITH A WARM MIX ADDITIVE

### NOTES:

- 1.) IF A TEMPORARY PATCH IS TO BE USED, THE CDF SHALL BE PLACED TO THE ELEVATION OF THE ADJOINING SUBGRADE, THEN GRAVEL SHALL BE PLACED AND COMPACTED TO WITHIN 3 1/2 INCHES OF THE FINISHED GRADE. THE LAST 3 1/2 INCHES SHALL BE HOT MIX ASPHALT PLACED IN TWO LAYERS: 1 1/2" SURFACE COURSE OVER 2" INTERMEDIATE COURSE.
- 2.) MATERIAL WHICH MEETS THE SPECIFICATION FOR GRAVEL BORROW TYPE C (M1.03.0 TYPE C), PLACED AND COMPACTED IN LAYERS NO GREATER THAN 6", MAY BE USED IN PLACE OF THE CDF WITH APPROVAL FROM THE DISTRICT HIGHWAY DIRECTOR.
- 3.) THE EXPOSED EDGES OF ALL LONGITUDINAL AND TRANSVERSE SAW CUT JOINTS SHALL BE TREATED WITH HOT POURED RUBBERIZED ASPHALT JOINT SEALANT MEETING MASSDOT SPECIFICATIONS.
- 4.) YELLOW METAL FOIL MARKING TAPE SHALL BE PLACED 18" OVER THE CONDUIT (METAL MARKING TAPE/WIRE SHOULD BE USED FOR NON-METALLIC CONDUIT.)
- 5.) FOR ROADS WITH AN EXISTING CEMENT CONCRETE BASE, A REINFORCED, HIGH EARLY STRENGTH AIR ENTRAINED, CLASS "F" CEMENT CONCRETE SLAB SHALL BE CAST IN PLACE TO MEET THE EXISTING PAVEMENT. SPECIFIC JOINT DETAILS WITH THE EXISTING PAVEMENT SHALL BE APPROVED DEPENDENT ON THE EXISTING SITE CONDITIONS.
- 6.) ALL TRENCH DIMENSIONS SHALL BE IN ACCORDANCE WITH SUB-SECTION 140.80 OF THE MASSDOT STANDARDS AND SPECIFICATIONS FOR HIGHWAYS AND BRIDGES.
- 7.) SIC 19.0 MAY BE SUBSTITUTED FOR SBC-37.5



## UTILITY TRENCH PERMANENT PAVEMENT REPAIR

DATE: 12.7.16

NTS

DRAWING NO.: XXXX

Drawn By:  
AFN

Checked By:  
AFN